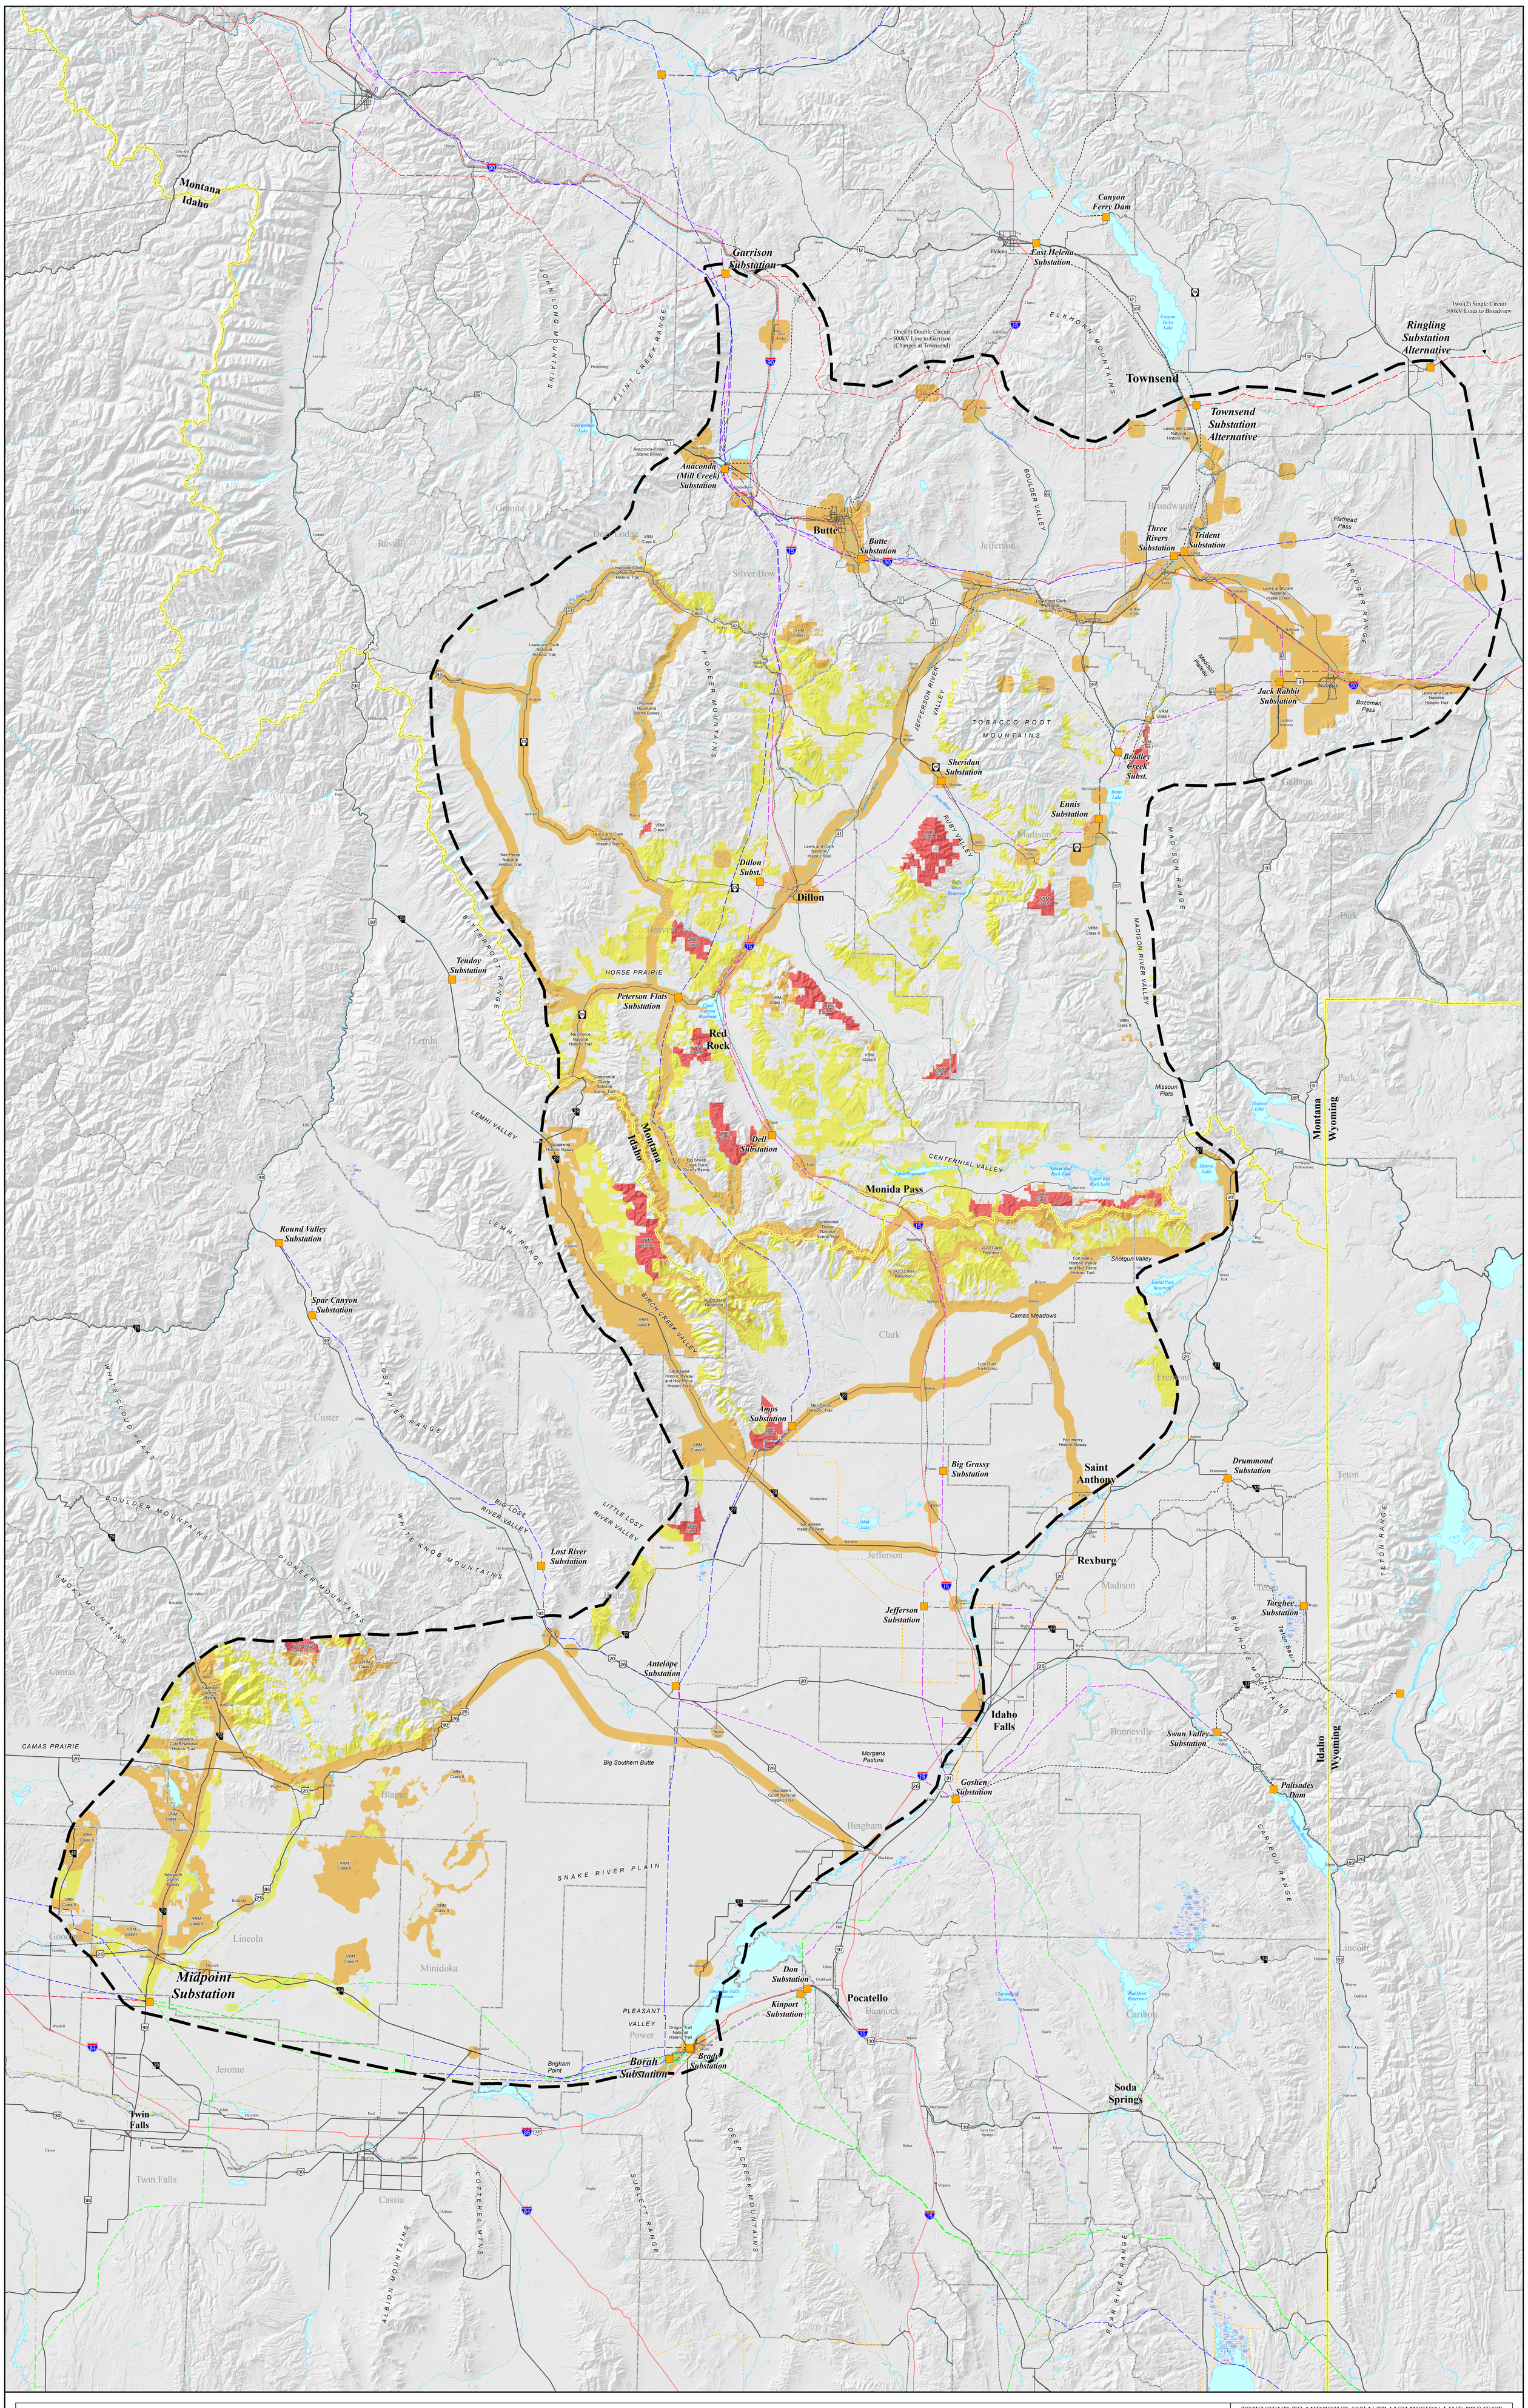
Montana
Idaho
Garrison Substation
Anaconda (Mill Creek) Substation
Butte
Butte Substation
East Helena Substation
Canyon Ferry Dam
Townsend
Townsend Substation Alternative
Ringling Substation Alternative
Two (2) Single Circuit 500kV Lines to Broadview
One (1) Double Circuit 500kV Line to Garrison (Changes at Townsend)
Three Rivers Substation
Trident Substation
Jack Rabbit Substation
Bradley Creek Subst.
Sheridan Substation
Ennis Substation
Dillon Subst.
Dillon
Tendoy Substation
Peterson Flats Substation
Red Rock
Dell Substation
Monida Pass
Round Valley Substation
Spar Canyon Substation
Amps Substation
Big Grassy Substation
Saint Anthony
Drummond Substation
Lost River Substation
Rexburg
Jefferson Substation
Targhee Substation
Antelope Substation
Idaho Falls
Swan Valley Substation
Goshen Substation
Palisades Dam
Midpoint Substation
Don Substation
Kinport Substation
Pocatello
Brady Substation
Borah Substation
Twin Falls
Soda Springs
Montana
Wyoming
Idaho
Wyoming
Big Southern Butte
Morgans Pasture
Brigham Point
Flathead Pass
Bozeman Pass
Missouri Flats
Shotgun Valley
Camas Meadows
Madison Plateau
Madison Range
Tobacco Root Mountains
Elkhorn Mountains
Boulder Valley
Jefferson River Valley
Ruby Valley
Lemhi Valley
Lemhi Range
Birch Creek Valley
Centennial Valley
Snake River Plain
Pleasant Valley
Camas Prairie
Big Lost River Valley
Little Lost River Valley
Lost River Range
White Cloud Peaks
Boulder Mountains
White Knob Mountains
Pioneer Mountains
Smoky Mountains
Bitterroot Range
Horse Prairie
Flint Creek Range
John Long Mountains
Big Hole Mountains
Bridger Range
Teton Range
Caribou Range
Bear River Range
Deep Creek Mountains
Sublett Range
Albion Mountains
Cotterel Mtns
Legend
Existing Transmission Lines
500kV Transmission Line
345kV Transmission Line
230kV Transmission Line
161kV Transmission Line
138kV Transmission Line
100 - 115kV Transmission Line
Under 100kV Transmission Line
Unknown Voltage Transmission Line
Substation
Divided Highway
Major Highway
Major Road
Other Road
Railroad
State Boundary
County Boundary
Lake or Pond
Exclusion Area
High Resource Sensitivity
Moderate Resource Sensitivity
Low Sensitivity or Routing Opportunity
TOWNSEND TO MIDPOINT 500kV TRANSMISSION LINE PROJECT
Exhibit 3 Visual Sensitivity
0 5 10 20 30
Miles
1:400,000
POWER ENGINEERS
Print Date : Nov 07, 2006
NorthWestern Energy