



Montana Department of
ENVIRONMENTAL QUALITY

Brian Schweitzer, Governor

P. O. Box 200901

Helena, MT 59620-0901

(406) 444-2544

Website: www.deq.mt.gov

August 8, 2011

Ms. Andrea Stomberg
Montana-Dakota Utilities
400 North Fourth Street
Bismarck, ND 59330-0201

RE: Final Title V Operating Permit #OP1551-06

Dear Ms. Stomberg:

The Department of Environmental Quality (Department) has prepared the enclosed Final Operating Permit #OP1551-06, for Montana-Dakota Utilities Company – Glendive Generating Station, located in Section 15, Township 15 North, Range 55 East, in Dawson County, Montana. Please review the cover page of the attached permit for information pertaining to the action taking place on Permit #OP1551-06.

If you have any questions, please contact Ed Warner, the permit writer, at (406) 444-2467 or by email at ewarner@mt.gov.

Sincerely,

Vickie Walsh
Air Permitting Program Supervisor
Air Resources Management Bureau
(406) 444-9741


Ed Warner
Environmental Science
Air Resources Management Bureau
(406) 444-2467

VW

Enclosure

Cc: Christopher Ajayi, US EPA Region VIII 8P-AR
Carson Coate, US EPA Region VIII, Montana Office

STATE OF MONTANA
Department of Environmental Quality
Helena, Montana 59620

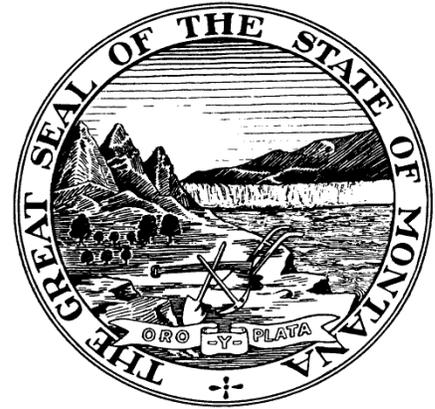

AIR QUALITY OPERATING PERMIT OP1551-06

Issued to: **Montana-Dakota Utilities Company
Glendive Generating Station
400 North Fourth Street
Bismarck, North Dakota 58501**

Final Date: **August 6, 2011**
Expiration Date: **August 6, 2016**

Effective Date: **August 6, 2011**
Date of Decision: **July 6, 2011**
End of EPA 45-day Review: **July 5, 2011**
Proposed Issue Date: **May 20, 2011**
Draft Issue Date: **April 18, 2011**

Application Deemed Technically Complete: **February 26, 2010**
Application Deemed Administratively Complete: **February 26, 2010**
Renewal Application Received: **February 26, 2010**
AFS Number: **030-021-0005A**

Permit Issuance and Appeal Processes: In accordance with Montana Code Annotated (MCA) Sections 75-2-217 and 218 and the Administrative Rules of Montana (ARM), ARM Title 17, Chapter 8, Subchapter 12, Operating Permit Program, this operating permit is hereby issued by the Department of Environmental Quality (Department) as effective and final on August 6, 2011. This permit must be kept on-site at the above named facility.

Montana Air Quality Operating Permit
Department of Environmental Quality

SECTION I.	GENERAL INFORMATION	1
SECTION II.	SUMMARY OF EMISSION UNITS.....	2
SECTION III.	PERMIT CONDITIONS	3
A.	FACILITY-WIDE	3
B.	EU001: 34-MW GENERAL ELECTRIC MS-6000 TURBINE/GENERATOR PEAKING PLANT (NATURAL GAS OR DIESEL)	6
C.	EU002: 43-MW GENERAL ELECTRIC LM-6000 TURBINE/GENERATOR PEAKING PLANT (NATURAL GAS OR DIESEL)	10
D.	EU003: 600-HP DETROIT DIESEL 7123-7300 STARTING MOTOR	16
E.	EU006: 2-MW EMERGENCY DIESEL GENERATOR	18
SECTION IV.	NON-APPLICABLE REQUIREMENTS	20
A.	FACILITY-WIDE	20
B.	EMISSION UNITS	20
SECTION V.	GENERAL PERMIT CONDITIONS.....	21
A.	COMPLIANCE REQUIREMENTS	21
B.	CERTIFICATION REQUIREMENTS	21
C.	PERMIT SHIELD.....	22
D.	MONITORING, RECORDKEEPING, AND REPORTING REQUIREMENTS	23
E.	PROMPT DEVIATION REPORTING.....	24
F.	EMERGENCY PROVISIONS	24
G.	INSPECTION AND ENTRY	25
H.	FEE PAYMENT.....	26
I.	MINOR PERMIT MODIFICATIONS	26
J.	CHANGES NOT REQUIRING PERMIT REVISION	26
K.	SIGNIFICANT PERMIT MODIFICATIONS.....	27
L.	REOPENING FOR CAUSE.....	28
M.	PERMIT EXPIRATION AND RENEWAL.....	28
N.	SEVERABILITY CLAUSE	29
O.	TRANSFER OR ASSIGNMENT OF OWNERSHIP.....	29
P.	EMISSIONS TRADING, MARKETABLE PERMITS, ECONOMIC INCENTIVES.....	29
Q.	NO PROPERTY RIGHTS CONVEYED.....	29
R.	TESTING REQUIREMENTS	29
S.	SOURCE TESTING PROTOCOL	29
T.	MALFUNCTIONS.....	29
U.	CIRCUMVENTION	30
V.	MOTOR VEHICLES	30
W.	ANNUAL EMISSIONS INVENTORY	30
X.	OPEN BURNING.....	30
Y.	MONTANA AIR QUALITY PERMITS.....	30
Z.	NATIONAL EMISSION STANDARD FOR ASBESTOS	31
AA.	ASBESTOS	31
BB.	STRATOSPHERIC OZONE PROTECTION – SERVICING OF MOTOR VEHICLE AIR CONDITIONERS	31
CC.	STRATOSPHERIC OZONE PROTECTION – RECYCLING AND EMISSION REDUCTIONS	31
DD.	EMERGENCY EPISODE PLAN.....	32
EE.	DEFINITIONS	32

APPENDIX A	INSIGNIFICANT EMISSION UNITS.....	A-1
APPENDIX B	DEFINITIONS AND ABBREVIATIONS	B-1
APPENDIX C	NOTIFICATION ADDRESSES	C-1
APPENDIX D	AIR QUALITY INSPECTOR INFORMATION.....	D-1
APPENDIX E	ACID RAIN	E-1
APPENDIX F	NO_x PEMS/CEMS	F-1

Terms not otherwise defined in this permit or in the Definitions and Abbreviations Appendix of this permit have the meaning assigned to them in the referenced regulations.

SECTION I. GENERAL INFORMATION

The following general information is provided pursuant to ARM 17.8.1210(1).

Company Name: Montana-Dakota Utilities Company

Mailing Address: 400 North Fourth Street

City: Bismarck

State: ND

Zip: 59330-0201

Plant Location: SE ¼ and Lot 4 of Section 15, Township 15 North, Range 55 East; Dawson County

Responsible Official: Andrea Stomberg

Phone: 701-222-7752

Alternate Responsible Official: Alan Welte

Phone: 701-222-7948

Facility Contact Person: Abbie Krebsbach

Phone: 701-222-7844

Primary SIC Code: 4911

Nature of Business: Electrical power generation, transmission, and distribution.

Description of Process: The Montana-Dakota Utilities Co. Glendive Generating Station uses two dual-fuel turbines for generating electricity as a peaking unit.

SECTION II. SUMMARY OF EMISSION UNITS

The emission units regulated by this permit are the following (ARM 17.8.1211):

Emissions Unit ID	Description	Pollution Control Device/Practice
EU001	34-MW General Electric MS-6000 Turbine/Generator Peaking Plant (Natural Gas or No. 2 Fuel Oil)	None
EU002	43-MW General Electric LM-6000 Turbine/Generator Peaking Plant (Natural Gas or No. 2 Fuel Oil)	Dry-Low NO _x combustor
EU003	600-hp Detroit Diesel 7123-7300 Starting Motor	None
EU006	2-MW Emergency Diesel Generator	None

SECTION III. PERMIT CONDITIONS

The following requirements and conditions are applicable to the facility or to specific emission units located at the facility (ARM 17.8.1211, 1212, and 1213).

A. Facility-Wide

Conditions	Rule Citation	Rule Description	Pollutant/Parameter	Limit
A.1	ARM 17.8.105	Testing Requirements	Testing Requirements	-----
A.2	ARM 17.8.304(1)	Visible Air Contaminants	Opacity	40%
A.3	ARM 17.8.304(2)	Visible Air Contaminants	Opacity	20%
A.4	ARM 17.8.308(1)	Particulate Matter, Airborne	Fugitive Opacity	20%
A.5	ARM 17.8.308(2)	Particulate Matter, Airborne	Reasonable Precautions	-----
A.6	ARM 17.8.308	Particulate Matter, Airborne	Reasonable Precaution, Construction	20%
A.7	ARM 17.8.309	Particulate Matter, Fuel Burning Equipment	Particulate Matter	$E = 0.882 * H^{-0.1664}$ Or $E = 1.026 * H^{-0.233}$
A.8	ARM 17.8.310	Particulate Matter, Industrial Processes	Particulate Matter	$E = 4.10 * P^{0.67}$ or $E = 55 * P^{0.11} - 40$
A.9	ARM 17.8.322(4)	Sulfur Oxide Emissions, Sulfur in Fuel	Sulfur in Fuel (liquid or solid fuels)	1 lb/MMBtu fired
A.10	ARM 17.8.322(5)	Sulfur Oxide Emissions, Sulfur in Fuel	Sulfur in Fuel (gaseous)	50 gr/100 CF
A.11	ARM 17.8.324(3)	Hydrocarbon Emissions, Petroleum Products	Gasoline Storage Tanks	-----
A.12	ARM 17.8.324	Hydrocarbon Emissions, Petroleum Products	65,000 Gallon Capacity	-----
A.13	ARM 17.8.324	Hydrocarbon Emissions, Petroleum Products	Oil-effluent Water Separator	-----
A.14	ARM 17.8.342	NESHAPs General Provisions	SSM Plans	Submittal
A.15	ARM 17.8.1211(1)(c) and 40 CFR Part 98	Greenhouse Gas Reporting	Reporting	-----
A.16	ARM 17.8.1212	Reporting Requirements	Prompt Deviation Reporting	-----
A.17	ARM 17.8.1212	Reporting Requirements	Compliance Monitoring	-----
A.18	ARM 17.8.1207	Reporting Requirements	Annual Certification	-----

Conditions

A.1. Pursuant to ARM 17.8.105, any person or persons responsible for the emission of any air contaminant into the outdoor atmosphere shall, upon written request of the Department, provide the facilities and necessary equipment (including instruments and sensing devices) and shall conduct tests, emission or ambient, for such periods of time as may be necessary using methods approved by the Department.

Compliance demonstration frequencies that list “as required by the Department” refer to ARM 17.8.105. In addition, for such sources, compliance with limits and conditions listing “as required by the Department” as the frequency, is verified annually using emission factors and engineering calculations by the Department’s compliance inspectors during the annual emission inventory review; in the case of Method 9 tests, compliance is monitored during the regular inspection by the compliance inspector.

A.2. Pursuant to ARM 17.8.304(1), Montana-Dakota shall not cause or authorize emissions to be discharged into the outdoor atmosphere from any source installed on or before November 23, 1968, that exhibit an opacity of 40% or greater averaged over 6 consecutive minutes, unless otherwise specified by rule or in this permit.

- A.3. Pursuant to ARM 17.8.304(2), Montana-Dakota shall not cause or authorize emissions to be discharged into the outdoor atmosphere from any source installed after November 23, 1968, that exhibit an opacity of 20% or greater averaged over 6 consecutive minutes, unless otherwise specified by rule or in this permit.
- A.4. Pursuant to ARM 17.8.308(1), Montana-Dakota shall not cause or authorize the production, handling, transportation, or storage of any material unless reasonable precautions to control emissions of particulate matter are taken. Such emissions of airborne particulate matter from any stationary source shall not exhibit an opacity of 20% or greater averaged over 6 consecutive minutes, unless otherwise specified by rule or in this permit.
- A.5. Pursuant to ARM 17.8.308(2), Montana-Dakota shall not cause or authorize the use of any street, road or parking lot without taking reasonable precautions to control emissions of airborne particulate matter, unless otherwise specified by rule or in this permit.
- A.6. Pursuant to ARM 17.8.308, Montana-Dakota shall not operate a construction site or demolition project unless reasonable precautions are taken to control emissions of airborne particulate matter. Such emissions of airborne particulate matter from any stationary source shall not exhibit an opacity of 20% or greater averaged over 6 consecutive minutes, unless otherwise specified by rule or in this permit.
- A.7. Pursuant to ARM 17.8.309, unless otherwise specified by rule or in this permit, Montana-Dakota shall not cause or authorize particulate matter caused by the combustion of fuel to be discharged from any stack or chimney into the outdoor atmosphere in excess of the maximum allowable emissions of particulate matter for existing fuel burning equipment and new fuel burning equipment calculated using the following equations:

For existing fuel burning equipment (installed before November 23, 1968):

$$E = 0.882 * H^{-0.1664}$$

For new fuel burning equipment (installed on or after November 23, 1968):

$$E = 1.026 * H^{-0.233}$$

Where H is the heat input capacity in million BTU (MMBtu) per hour and E is the maximum allowable particulate emissions rate in pounds per MMBtu.

- A.8. Pursuant to ARM 17.8.310, unless otherwise specified by rule or in this permit, Montana-Dakota shall not cause or authorize particulate matter to be discharged from any operation, process, or activity into the outdoor atmosphere in excess of the maximum hourly allowable emissions of particulate matter calculated using the following equations:

$$\begin{array}{ll} \text{For process weight rates up to 30 tons per hour:} & E = 4.10 * P^{0.67} \\ \text{For process weight rates in excess of 30 tons per hour:} & E = 55.0 * P^{0.11} - 40 \end{array}$$

Where E = rate of emissions in pounds per hour and P = process weight rate in tons per hour.

- A.9. Pursuant to ARM 17.8.322(4), Montana-Dakota shall not burn liquid or solid fuels containing sulfur in excess of 1 pound per million BTU fired, unless otherwise specified by rule or in this permit.

- A.10. Pursuant to ARM 17.8.322(5), Montana-Dakota shall not burn any gaseous fuel containing sulfur compounds in excess of 50 grains per 100 cubic feet of gaseous fuel, calculated as hydrogen sulfide at standard conditions, unless otherwise specified by rule or in this permit.
- A.11. Pursuant to ARM 17.8.324(3), Montana-Dakota shall not load or permit the loading of gasoline into any stationary tank with a capacity of 250 gallons or more from any tank truck or trailer, except through a permanent submerged fill pipe, unless such tank is equipped with a vapor loss control device or is a pressure tank as described in ARM 17.8.324(1), unless otherwise specified by rule or in this permit.
- A.12. Pursuant to ARM 17.8.324, unless otherwise specified by rule or in this permit, Montana-Dakota shall not place, store or hold in any stationary tank, reservoir or other container of more than 65,000 gallon capacity any crude oil, gasoline or petroleum distillate having a vapor pressure of 2.5 pounds per square inch absolute or greater under actual storage conditions, unless such tank, reservoir or other container is a pressure tank maintaining working pressure sufficient at all times to prevent hydrocarbon vapor or gas loss to the atmosphere, or is designed and equipped with a vapor loss control device, properly installed, in good working order and in operation.
- A.13. Pursuant to ARM 17.8.324, unless otherwise specified by rule or in this permit, Montana-Dakota shall not use any compartment of any single or multiple-compartment oil-effluent water separator, which compartment receives effluent water containing 200 gallons a day or more of any petroleum product from any equipment processing, refining, treating, storing or handling kerosene or other petroleum product of equal or greater volatility than kerosene, unless such compartment is equipped with a vapor loss control device, constructed so as to prevent emission of hydrocarbon vapors to the atmosphere, properly installed, in good working order and in operation.
- A.14. Pursuant to ARM 17.8.342 and 40 CFR 63.6, Montana-Dakota shall submit to the Department a copy of any startup, shutdown, and malfunction (SSM) plan required under 40 Code of Federal Regulation (CFR) 63.6(e)(3) within 30 days of the effective date of this operating permit (if not previously submitted), within 30 days of the compliance date of any new National Emission Standard for Hazardous Air Pollutants (NESHAPs) or Maximum Achievable Control Technology (MACT) standard, and within 30 days of the revision of any such SSM plan, when applicable. The Department requests submittal of such plans in electronic form, when possible.
- A.15. Pursuant to ARM 17.8.1211(1)(c) and 40 CFR Part 98, Montana-Dakota shall comply with requirements of 40 CFR Part 98 – Mandatory Greenhouse Gas Reporting, as applicable (ARM 17.8.1211(1)(c), NOT an applicable requirement under Title V).
- A.16. Montana-Dakota shall promptly report deviations from permit requirements including those attributable to upset conditions, as upset is defined in the permit. To be considered prompt, deviations shall be reported to the Department using the schedule and content as described in Section V.E (unless otherwise specified in an applicable requirement) (ARM 17.8.1212).
- A.17. On or before February 15 and August 15 of each year, Montana-Dakota shall submit to the Department the compliance monitoring reports required by Section V.D. These reports must contain all information required by Section V.D, as well as the information required by each individual emissions unit. For the reports due by February 15 of each year, Montana-Dakota may submit a single report, provided that it contains all the information required by Section V.B & V.D. Per ARM 17.8.1207,

any application form, report, or compliance certification submitted pursuant to ARM Title 17, Chapter 8, Subchapter 12 (including semiannual monitoring reports), shall contain certification by a

responsible official of truth, accuracy and completeness. This certification and any other certification required under ARM Title 17, Chapter 8, Subchapter 12, shall state that, “based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate and complete.”

A.18. By February 15 of each year, Montana-Dakota shall submit to the Department the compliance certification required by Section V.B. The annual certification required by Section V.B must include a statement of compliance based on the information available which identifies any observed, documented or otherwise known instance of noncompliance for each applicable requirement. Per ARM 17.8.1207,

any application form, report, or compliance certification submitted pursuant to ARM Title 17, Chapter 8, Subchapter 12 (including annual certifications), shall contain certification by a responsible official of truth, accuracy and completeness. This certification and any other certification required under ARM Title 17, Chapter 8, Subchapter 12, shall state that, “based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate and complete.”

B. EU001: 34-MW General Electric MS-6000 Turbine/Generator Peaking Plant (Natural Gas or Diesel)

Permit Condition	Pollutant/ Parameter	Permit Limitation	Compliance Demonstration		Reporting Requirement
			Method	Frequency	
B.1, B.8, B.16, B.20, B.21, B.22	Opacity	20%	While burning refinery quality No.1 or No.2 fuel oil, the method of compliance is a Method 9	As required by the Department and Section III.A.1	Semiannual
			Otherwise, the method is burning pipeline quality natural gas	Ongoing	Semiannual
B.2, B.9, B.17, B.21, B.22	Particulate from fuel combustion	$E=1.026^* H^{-0.233}$	Refinery quality No. 1 or No.2 fuel oil or pipeline quality natural gas	Ongoing	Semiannual
B.3, B.10, B.17, B.21, B.22	Sulfur compounds in fuel (gaseous)	<u>50 grains</u> 100 SCF	Burning pipeline quality natural gas	Ongoing	Semiannual
B.4, B.11, B.17, B.18, B.21, B.22	Sulfur compound in fuel (liquid)	1 lb/MMBtu fired	While burning refinery quality No.1 No.2 fuel oil, the method is a fuel analysis provided by the fuel supplier	Ongoing	Semiannual
			Otherwise, the method is burning pipeline quality natural gas	Ongoing	Semiannual

Permit Condition	Pollutant/ Parameter	Permit Limitation	Compliance Demonstration		Reporting Requirement
			Method	Frequency	
B.5, B.12, B.17, B.21, B.22	Fuel type	Pipeline quality natural gas or refinery quality No.1 or No.2 fuel oil	Log of fuel type used	Monthly	Semiannual
B.6, B.13, B.17, B.21, B.22	Operational limit when burning only pipeline quality natural gas	2620 hours	Log hours of operation and corresponding fuel used	Ongoing	Semiannual
B.6, B.13, B.17, B.21, B.22	Operational limit when burning only No. 1 or No. 2 fuel oil	1667 hours	Log hours of operation and corresponding fuel used	Ongoing	Semiannual
B.6, B.13, B.17, B.21, B.22	Operational limit when burning a combination of pipeline quality natural gas and No.1 or No.2 fuel oil in the same year	"X hours" on a rolling 12-month basis "X hours" shall be determined as follows: X= 2,620 hours - 1.572 * Y hours	Log hours of operation and corresponding fuel used	Ongoing	Semiannual
B.7, B.14, B.15, B.16, B.17, B.19, B.21, B.22	NO _x	225 tons per rolling 12-month period using the following equation: Total Emissions (tons) = ((A hours * ERG)+(B hours * ERF))/2000	Log hours of operation of the turbine according to fuel used Use the emission rates from the most recent source test on file with the Department	Monthly	Semiannual

Conditions

- B.1. Montana-Dakota shall not cause or authorize emissions to be discharged into the outdoor atmosphere from any source that exhibits an opacity of 20% or greater averaged over 6 consecutive minutes (ARM 17.8.304(1)).
- B.2. Montana-Dakota shall not cause or authorize particulate matter caused by the combustion of fuel to be discharged from any stack or chimney into the outdoor atmosphere in excess of $E = 1.026 * H^{-0.233}$ for new fuel burning equipment, where: H = heat input capacity in MMBtu/hr and E = maximum allowable emission rate in lb/MMBtu (ARM 17.8.309).
- B.3. Montana-Dakota shall not burn any gaseous fuel containing sulfur compounds in excess of 50 grains per 100 standard cubic feet of gaseous fuel, calculated as hydrogen sulfide at standard conditions (ARM 17.8.322(5)).
- B.4. Montana-Dakota shall not burn any liquid fuel containing sulfur compounds in excess of 1 lb/MMBtu of liquid fired (ARM 17.8.322(4)).

- B.5. Montana-Dakota shall only combust pipeline quality natural gas or refinery quality No.1 or No.2 fuel oil in the turbine (ARM 17.8.752).
- B.6. Montana-Dakota shall not operate the General Electric MS-6000 Turbine (Unit 1) for more than the following:
- a. 2,620 hours per year on a rolling 12-month basis when combusting pipeline quality natural gas (ARM 17.8.752);
 - b. 1,667 hours per year on a rolling 12-month basis when combusting No.1 or No.2 fuel oil (ARM 17.8.752); and
 - c. "X hours" on a rolling 12-month basis when pipeline quality natural gas and No.1 or No.2 fuel oil are combusted during a given year. "X hours" shall be determined as follows; (ARM 17.8.752):
 - i. $X = 2,620 \text{ hours} - 1.572 * Y \text{ hours}$ (2620 hrs > X > 1667 hrs)
 - ii. Where X = Total adjusted hours of operation
 - iii. Y = number of hours burning No. 1 or No. 2 Fuel oil
 - iv. 2620 = Hours of natural gas operation
 - v. 1.572 = the ratio of emissions from burning No. 1 or No. 2 Fuel oil compared to natural gas.
- B.7. Montana-Dakota shall not exceed 225 tons of total nitrogen oxides (NO_x) emissions from Unit 1 (combusting pipeline quality natural gas or a combination of pipeline quality natural gas and No.1 or No.2 fuel oil) and its associated startup engine per rolling 12-month period (ARM 17.8.752).

Compliance Demonstration

- B.8. As required by the Department and Section III.A.1, Montana-Dakota shall conduct a Method 9 test to monitor compliance with the opacity limit in Section III.B.1 while burning refinery quality No. 1 or No. 2 fuel oil. Method 9 tests shall be performed in accordance with the Montana Source Test Protocol and Procedure Manual. Otherwise, Montana-Dakota shall monitor compliance with the opacity requirement by burning pipeline quality natural gas on a continuous basis (ARM 17.8.106 and ARM 17.8.1213).
- B.9. Monitoring compliance with the particulate from fuel combustion requirement shall be satisfied by burning refinery quality No.1 or No.2 fuel oil or pipeline quality natural gas on a continuous basis (ARM 17.8.1213).
- B.10. Monitoring compliance with the sulfur compounds in fuel (gaseous) requirements shall be satisfied by burning pipeline quality natural gas on a continuous basis. While burning No.1 or No.2 fuel oil, the sulfur compounds in fuel (gaseous) requirements do not apply (ARM 17.8.1213).
- B.11. Monitoring compliance with the sulfur compounds in fuel (liquid) requirements may be satisfied by annually providing a fuel analysis while burning No.1 or No.2 fuel oil. The analysis must demonstrate that the No.1 or No.2 fuel oil is less than 1 pound/million Btu fired. Otherwise, the method of compliance is burning pipeline quality natural gas on a continuous basis (ARM 17.8.1213).

- B.12. Montana-Dakota shall log, by month, the type of fuel used to operate Unit 1 to monitor compliance with Section III.B.5 (ARM 17.8.1213).
- B.13. Montana-Dakota shall document, by month, the number of hours that Unit 1 combusted pipeline quality natural gas, No.1 or No.2 fuel oil, and the corresponding adjusted hours of operation (as defined in Section III B.6.c.ii) while burning pipeline quality natural gas and No.1 or No.2 fuel oil during the previous rolling 12-month period. By the 25th of each month, Montana-Dakota shall total the hours that Unit 1 combusted pipeline quality natural gas, No.1 or No.2 fuel oil, and the corresponding adjusted hours of operation while burning pipeline quality natural gas and No.1 or No.2 fuel oil during the previous 12 months to verify compliance with the limitations in Section III.B.6.a, III.B.6.b, and III.B.6.c. A written report of the compliance verification shall be submitted along with the annual emissions inventory (ARM 17.8.1213).
- B.14. Compliance with Section III.B.7 is determined when total NO_x emissions are less than or equal to 225 total tons, using the following equations on a rolling 12-month basis (ARM 17.8.1213):

$$\text{Total emissions (tons)} = ((A \text{ hours} * \text{ERG}) + (B \text{ hours} * \text{ERF})) / 2000$$

Where, A hours = actual hours of operation when combusting natural gas;

B hours = actual hours of operation when combusting No. 1 or No. 2 Fuel Oil;

ERG = hourly NO_x emission rate (lb/hr) when combusting natural gas; and

ERF = hourly NO_x emission rate (lb/hr) when combusting No. 1 or No. 2 fuel oil.

Emission rates for each "hours of operation" shall be calculated as follows:

NO_x Emissions = hours of operation using a specific fuel X stack test (lb/hr).

The most recent source test submitted to the Department by Montana-Dakota-Glendive for the turbine shall be used to obtain the hourly emission rate (lb/hr).

- B.15. Montana-Dakota shall test the Unit 1 turbine and demonstrate compliance with the NO_x emission limit contained in Section III.B.7 within 40 days of the total hours of operation equaling 1,620 in any 12-month period. The turbine shall be tested using the major fuel combusted during the previous 500 hours of operation. All testing and reporting of tests shall include a determination of the amount of NO_x emissions from the turbine. Testing is not required to be conducted more frequently than once every 4 years, regardless of hours operated (ARM 17.8.749, ARM 17.8.106, and ARM 17.8.1213).

Recordkeeping

- B.16. All compliance source test recordkeeping shall be performed in accordance with the test method used and the Montana Source Test Protocol and Procedures Manual, and shall be maintained on site or under Montana-Dakota's control (ARM 17.8.106 and ARM 17.8.1212).
- B.17. Montana-Dakota shall maintain a log of the hours of operation of the turbine according to the fuel burned (pipeline quality natural gas or No.1 or No.2 fuel oil). The log shall identify the date and time that fuel types are changed. The log must be maintained on-site (Montana-Dakota-Glendive Generating Station) and must be submitted to the Department upon request (ARM 17.8.749 and 17.8.1212).

- B.18. Montana-Dakota shall maintain a record of the fuel analyses provided by the fuel provider or conducted by an independent laboratory for the fuel types used during the previous 12-month period (ARM 17.8.1212).
- B.19. Montana-Dakota shall document, by month, the NO_x emissions from Unit 1 and its associated startup engine. By the 25th of each month, Montana-Dakota shall total the NO_x emissions from Unit 1 and its associated startup engine during the previous 12 months to verify compliance with the limitation in Section III.B.14 (ARM 17.8.1212).

Reporting

- B.20. Any compliance source test reports must be submitted in accordance with the Montana Source Test Protocol and Procedures Manual (ARM 17.8.106 and ARM 17.8.1212).
- B.21. The annual compliance certification required by Section V.B must contain a certification statement for the above applicable requirements (ARM 17.8.1212).
- B.22. The semiannual monitoring report shall provide (ARM 17.8.1212):
- a. A summary of results of any source testing that was performed during that semiannual period;
 - b. Reports of any required monitoring performed during the reporting period, with all instances of deviations from any permit requirements identified.
 - c. A summary of the record of the fuel analyses used during the previous 12-month period;
 - d. A summary of the log of the hours of operation of the turbine according to the fuel burned; and
 - e. A summary of the log required in Section III.B.19 monitoring compliance with the NO_x emission limit. The summary shall include a rolling 12-month average for each month in the reporting period.

C. EU002: 43-MW General Electric LM-6000 Turbine/Generator Peaking Plant (Natural Gas or Diesel)

Condition(s)	Pollutant/Parameter	Permit Limit	Compliance Demonstration		Reporting Requirements
			Method	Frequency	
C.1, C.14, C.25, C.31, C.32, C.33	Opacity	20%	While burning refinery quality No.1 or No.2 fuel oil, the method of compliance is a Method 9	As required by the Department and Section III.A.1	Semiannual
			Otherwise, the method is burning pipeline quality natural gas	Ongoing	Semiannual
C.2, C.15, C.26, C.32, C.33	Particulate from fuel combustion	$E=1.026^* H^{-0.233}$	Refinery quality No.1 or No.2 fuel oil or pipeline quality natural gas	Ongoing	Semiannual

Condition(s)	Pollutant/Parameter	Permit Limit	Compliance Demonstration		Reporting Requirements
			Method	Frequency	
C.3, C.16, C.26, C.32, C.33	Sulfur compounds in fuel (gaseous)	<u>50 grains</u> 100 SCF	Burning pipeline quality natural gas	Ongoing	Semiannual
C.4, C.17, C.27, C.32, C.33	Sulfur compound in fuel (liquid)	<u>1 pound</u> million Btu fired	While burning refinery quality No.1 or No.2 fuel oil, the method is a fuel analysis provided by the fuel supplier	Annual	Semiannual
			Otherwise, the method is burning pipeline quality natural gas	Ongoing	Semiannual
C.5, C.18, C.26, C.32, C.33	Fuel type	Pipeline quality natural gas or refinery quality No.1 or No.2 fuel oil	Log of fuel type used	Monthly	Semiannual
C.6, C.19, C.26, C.32, C.33	Operational limit when burning only pipeline quality natural gas	6500 hours	Log hours of operation and corresponding fuel used	Ongoing	Semiannual
C.6, C.19, C.26, C.32, C.33	Operational limit when burning only No. 1 or No. 2 fuel oil	3254 hours	Log hours of operation and corresponding fuel used	Ongoing	Semiannual
C.6, C.19, C.26, C.32, C.33	Operational limit when burning a combination of pipeline quality natural gas and No.1 or No.2 fuel oil in the same year	"X hours" on a rolling 12-month basis "X hours" shall be determined as follows: X= 6500 hours - 1.998 * Y hours	Log hours of operation and corresponding fuel used	Ongoing	Semiannual
C.7, C.20, C.25, C.28, C.31, C.32, C.33	NO _x	247 tons per rolling 12 month period using the following equation: Total Emissions (tons) = ((A hours * ERG)+(B hours * ERF))/2000	Performance Test Log hours of operation of the turbine according to fuel used Use the emission rates from the most recent source test on file with the Department	Monthly	Semiannual

Condition(s)	Pollutant/Parameter	Permit Limit	Compliance Demonstration		Reporting Requirements
			Method	Frequency	
C.8, C.21, C.25, C.31, C.32, C.33	NOx Emission Limit while combusting pipeline quality natural gas	76.0 lb/hr	Performance Test	Biennial or as requested by the Department	Semiannual
C.9, C.21, C.25, C.31, C.32, C.33	CO Emission Limit while combusting pipeline quality natural gas	17.0 lb/hr	Performance Test	Biennial or as requested by the Department	Semiannual
C.10, C.22, C.25, C.31, C.32, C.33	NOx Emission Limit while combusting No. 2 fuel oil	151.8 lb/hr	Performance Test	Biennial or as requested by the Department	Semiannual
C.11, C.22, C.25, C.31, C.32, C.33	SO2 Emission Limit while combusting No. 2 fuel oil	90.8 lb/hr	Performance Test	Biennial or as requested by the Department	Semiannual
C.12, C.23, C.29, C.32, C.33	Acid Rain Provisions	40 CFR 72-78 and Appendix F	40 CFR 72-78 and Appendix F	As required by Appendix F	Quarterly
C.13, C.24, C.30, C.32, C.33	40 CFR 60, Subpart GG	40 CFR 60, Subpart GG	40 CFR 60, Subpart GG	Ongoing	Semiannual

Conditions

- C.1. Montana-Dakota shall not cause or authorize emissions to be discharged into the outdoor atmosphere from any source that exhibits an opacity of 20% or greater averaged over 6 consecutive minutes (ARM 17.8.304(1)).
- C.2. Montana-Dakota shall not cause or authorize particulate matter caused by the combustion of fuel to be discharged from any stack or chimney into the outdoor atmosphere in excess of $E = 1.026 * H^{-0.233}$ for new fuel burning equipment, where: H = heat input capacity in MMBtu/hr and E = maximum allowable emission rate in lb/MMBtu (ARM 17.8.309).
- C.3. Montana-Dakota shall not burn any gaseous fuel containing sulfur compounds in excess of 50 grains per 100 standard cubic feet of gaseous fuel, calculated as hydrogen sulfide at standard conditions (ARM 17.8.322(5)).
- C.4. Montana-Dakota shall not burn any liquid fuel containing sulfur compounds in excess of 1 lb/MMBtu of liquid fired (ARM 17.8.322(4)).
- C.5. Montana-Dakota shall only combust pipeline quality natural gas or refinery quality No. 1 or No. 2 fuel oil in the turbine (ARM 17.8.752).
- C.6. Montana-Dakota shall not operate the General Electric LM-6000 Turbine for more than the following:
- a. 6500 hours per year on a rolling 12-month basis when combusting pipeline quality natural gas (ARM 17.8.752)
 - b. 3254 hours per year on a rolling 12-month basis when combusting No.1 or No.2 fuel oil (ARM 17.8.752)

- c. "X hours" on a rolling 12-month basis when pipeline quality natural gas and No.1 or No.2 fuel oil are combusted during a given year. "X hours" shall be determined as follows:
- i. $X = 6500 \text{ hours} - 1.998 * Y \text{ hours}$ (6500 hrs > X > 3254 hrs)
 - ii. Where X = Total adjusted hours of operation
 - iii. Y = number of hours burning No. 1 or No. 2 Fuel oil
 - iv. 6500 = Hours of natural gas operation
 - v. 1.998 = the ratio of emissions from burning No. 1 or No. 2 Fuel oil compared to natural gas; (ARM 17.8.752).
- C.7. Montana-Dakota shall limit the hours of operation and/or the fuel combusted such that the sum of the NO_x emissions from Unit 2 do not exceed 247 tons per rolling 12-month period when combusting pipeline quality natural gas, No.1 or No.2 fuel oil, or a combination of pipeline quality natural gas and No.1 or No.2 fuel oil. Any calculations used to establish NO_x emissions shall be approved by the Department (ARM 17.8.752).
- C.8. NO_x emissions from Unit 2, while combusting pipeline quality natural gas, shall not exceed 76.0 lb/hr (ARM 17.8.749).
- C.9. Carbon monoxide (CO) emissions from Unit 2, while combusting pipeline quality natural gas, shall not exceed 17.0 lb/hr (ARM 17.8.749).
- C.10. NO_x emissions from Unit 2, while combusting No.1 or No.2 fuel oil, shall not exceed 151.8 lb/hr (ARM 17.8.749).
- C.11. Sulfur dioxide (SO₂) emissions from Unit 2, while combusting No.1 or No.2 fuel oil, shall not exceed 90.8 lb/hr (ARM 17.8.749).
- C.12. Montana-Dakota shall comply with all applicable standards and limitations, and the reporting, recordkeeping, and notification requirements of the Acid Rain Program contained in 40 CFR 72-78 (40 CFR 72-78).
- C.13. Montana-Dakota shall comply with all of the applicable requirements, including emission limitations, monitoring, recordkeeping, reporting, and testing requirements, of 40 CFR 60, Subpart A, General Provisions, and Subpart GG, Standards of Performance for Stationary Gas Turbines (ARM 17.8.340 and 40 CFR 60, Subpart GG).

Compliance Demonstration

- C.14. As required by the Department and Section III.A.1, Montana-Dakota shall conduct a Method 9 test to monitor compliance with the opacity limit in Section III.C.1 while burning refinery quality No. 1 or No. 2 fuel oil. Method 9 tests shall be performed in accordance with the Montana Source Test Protocol and Procedure Manual. Otherwise, Montana-Dakota shall monitor compliance with the opacity requirement by burning pipeline quality natural gas on a continuous basis (ARM 17.8.106 and ARM 17.8.1213).
- C.15. Monitoring compliance with the particulate from fuel combustion requirement may be satisfied by burning refinery quality No.1 or No.2 fuel oil or pipeline quality natural gas on a continuous basis (ARM 17.8.1213).

- C.16. Monitoring compliance with the sulfur compounds in fuel (gaseous) requirements may be satisfied by burning pipeline quality natural gas on a continuous basis. While burning No.1 or No.2 fuel oil, the sulfur compounds in fuel (gaseous) requirements do not apply (ARM 17.8.1213).
- C.17. Monitoring compliance with the sulfur compounds in fuel (liquid) requirements may be satisfied by annually providing a fuel analysis while burning No.1 or No.2 fuel oil. The analysis must demonstrate that the No.1 or No.2 fuel oil is less than 1 pound/million Btu fired. Otherwise, the method of compliance is burning pipeline quality natural gas on a continuous basis (ARM 17.8.1213).
- C.18. Montana-Dakota shall log, by month, the types of fuel used to operate Unit 2 to monitor compliance with Section III.C.5 (ARM 17.8.1213).
- C.19. Montana-Dakota shall document, by month, the number of hours that Unit 2 combusted pipeline quality natural gas, No.1 or No.2 fuel oil, and the corresponding adjusted hours of operation (as defined in Section III C.6.c.ii) while burning pipeline quality natural gas and No.1 or No.2 fuel oil during the previous rolling 12-month period. By the 25th of each month, Montana-Dakota shall total the hours that Unit 2 combusted pipeline quality natural gas, No.1 or No.2 fuel oil, and the corresponding adjusted hours of operation while burning pipeline quality natural gas and No.1 or No.2 fuel oil during the previous 12-months to verify compliance with the limitations in Section III.C.6.a, 6.b, and 6.c. A written report of the compliance verification shall be submitted along with the annual emissions inventory (ARM 17.8.749 and ARM 17.8.1213).
- C.20. Montana-Dakota shall document, by month, the NO_x emissions from Unit 2. By the 25th of each month, Montana-Dakota shall total the NO_x emissions from Unit 2 during the previous 12 months to verify compliance with the limitation in Section III.C.7. Unless an alternate equation has been approved by the Department, compliance shall be determined using the following equation. A written report of the compliance verification shall be submitted along with the annual emissions inventory (ARM 17.8.1213).

$$\text{Total emissions (tons)} = ((A \text{ hours} * \text{ERG}) + (B \text{ hours} * \text{ERF})) / 2000$$

Where, A hours = actual hours of operation when combusting natural gas;

B hours = actual hours of operation when combusting No. 1 or No. 2 Fuel Oil;

ERG = hourly emission rate (lb/hr) when combusting natural gas; and

ERF = hourly emission rate (lb/hr) when combusting No. 1 or No. 2 fuel oil.

Emission rates for each "hours of operation" shall be calculated as follows:

NO_x Emissions = hours of operation using a specific fuel X stack test (lb/hr).

The most recent source test submitted to the Department by Montana-Dakota for the turbine shall be used to obtain the hourly emission rate (lb/hr).

- C.21. Montana-Dakota shall test the Unit 2 turbine and demonstrate compliance with the NO_x and carbon monoxide (CO) emission limits contained in Section III.C.8 and III.C.9 of this permit. The performance test shall be conducted while the Unit 2 turbine is combusting natural gas. Testing shall occur on an every 2-year basis or according to another testing/monitoring schedule as may be approved by the Department. All testing and reporting of tests shall include a determination of the amount of NO_x emissions from the turbine (ARM 17.8.106, ARM 17.8.749, and ARM 17.8.1213).

- C.22. Montana-Dakota shall test the Unit 2 turbine and demonstrate compliance with the NO_x and SO₂ emission limits contained in Section III.C.10 and III.C.11 of this permit. The performance test shall be conducted while the Unit 2 turbine is combusting No.1 or No.2 fuel oil. Testing shall occur on an every 2-year basis or according to another testing/monitoring schedule as may be approved by the Department. All testing and reporting of tests shall include a determination of the amount of NO_x and the amount of NO₂ emissions from the turbine (ARM 17.8.749 and ARM 17.8.106).
- C.23. Compliance monitoring for the applicable requirements contained in 40 CFR 72-78 shall be accomplished as described in 40 CFR 72-78 (40 CFR 72-78 and ARM 17.8.1213).
- C.24. Compliance monitoring for the applicable requirements contained in 40 CFR 60 Subpart GG shall be accomplished as described in 40 CFR 60, Subpart GG (ARM 17.8.342 and 40 CFR 60, Subpart GG).

Recordkeeping

- C.25. All compliance source test recordkeeping shall be performed in accordance with the test method used and the Montana Source Test Protocol and Procedures Manual, and shall be maintained on site or under Montana-Dakota's control (ARM 17.8.106 and ARM 17.8.1212).
- C.26. Montana-Dakota shall maintain a log of the hours of operation of the turbine according to the fuel burned (pipeline quality natural gas or No.1 or No.2 fuel oil). The log shall identify the date and time that fuel types are changed. The log must be maintained on-site (Montana-Dakota-Glendive Generating Station) and must be submitted to the Department upon request (ARM 17.8.749 and 17.8.1212).
- C.27. Montana-Dakota shall maintain a record of the fuel analyses provided by the fuel provider or conducted by an independent laboratory for the fuel types used during the previous 12-month period (ARM 17.8.1212).
- C.28. Montana-Dakota shall maintain a log of the NO_x emissions from Unit 2, by month, using the equation from Section III.C.20 to account for the NO_x emissions corresponding to the type of fuel burned (ARM 17.8.1212).
- C.29. Montana-Dakota shall perform recordkeeping in accordance with 40 CFR 72-78, as applicable and as required by Appendix E and F of this permit (40 CFR 72-78 and ARM 17.8.1212).
- C.30. Montana-Dakota shall perform recordkeeping in accordance with 40 CFR 60, Subpart GG (ARM 17.8.1212 and 40 CFR 60, Subpart GG).

Reporting

- C.31. Any compliance source test reports must be submitted in accordance with the Montana Source Test Protocol and Procedures Manual (ARM 17.8.106 and ARM 17.8.1212).
- C.32. The annual compliance certification required by Section V.B must contain a certification statement for the above applicable requirements (ARM 17.8.1212).

C.33. The semiannual monitoring report shall provide (ARM 17.8.1212):

- a. A summary of results of any source testing that was performed during that semiannual period;
- b. Reports of any required monitoring performed during the reporting period, with all instances of deviations from any permit requirements identified;
- c. A summary of the hours Unit 2 combusted pipeline quality natural gas and No.1 or No.2 fuel oil on a rolling 12-month basis;
- d. A summary of the record of the fuel analyses for the fuel types used during the previous 12-month period;
- e. A summary of the log of the hours of operation of the turbine according to the fuel burned;
- f. A summary of the log required in Section III.C.28 monitoring compliance with the NO_x emission limit. The summary shall include a rolling 12-month average for each month in the reporting period; and
- g. A summary of compliance with the requirements of 40 CFR 72-78, as applicable.

D. EU003: 600-hp Detroit Diesel 7123-7300 Starting Motor

Condition(s)	Pollutant/Parameter	Permit Limit	Compliance Demonstration		Reporting Requirements
			Method	Frequency	
D.1, D.5, D.9, D.13, D.14, D.15	Opacity	20%	Method 9	As required by the Department and Section III.A.1	Semiannual
D.2, D.6, D.10, D.14, D.15	Particulate from fuel combustion	$E=1.026^* H^{-0.233}$	Refinery quality No.1 or No.2 fuel oil	Ongoing	Semiannual
D.3, D.7, D.11, D.14, D.15	Sulfur compound in fuel (liquid)	<u>1 pound</u> million Btu fired	Fuel analysis	Annual	Semiannual
D.4, D.8, D.12, D.15	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ

Conditions

- D.1. Montana-Dakota shall not cause or authorize emissions to be discharged into the outdoor atmosphere from any source that exhibits an opacity of 20% or greater averaged over 6 consecutive minutes (ARM 17.8.304(2)).
- D.2. Montana-Dakota shall not cause or authorize particulate matter caused by the combustion of fuel to be discharged from any stack or chimney into the outdoor atmosphere in excess of $E = 1.026^* H^{-0.233}$ for new fuel burning equipment, where: H = heat input capacity in MMBtu/hr and E = maximum allowable emission rate in lb/MMBtu (ARM 17.8.309).
- D.3. Montana-Dakota shall not burn any liquid fuel containing sulfur compounds in excess of 1 pound per million Btu of liquid fuel fired (ARM 17.8.322(4)).

- D.4. Montana-Dakota shall comply with all applicable standards, limitations and the reporting, recordkeeping, and notification requirements of 40 CFR 60, Subpart IIII (Standards of Performance for Stationary Compression Ignition Internal Combustion Engines) and 40 CFR 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines) (ARM 17.8.340).

Compliance Demonstration

- D.5. Montana-Dakota shall burn only refinery quality No. 1 or No. 2 fuel oil or conduct a Method 9 test as required by the Department and Section III.A.1 to monitor compliance with the opacity limitation in Section III.D.1. Method 9 tests shall be performed in accordance with the Montana Source Test Protocol and Procedures Manual (ARM 17.8.749 and ARM 17.8.106).
- D.6. Monitoring compliance with the particulate from fuel combustion requirement may be satisfied by burning refinery quality No.1 or No.2 fuel oil or pipeline quality natural gas on a continuous basis (ARM 17.8.1213).
- D.7. Monitoring compliance with the sulfur compounds in fuel (liquid) requirements shall be satisfied by annually providing a supplier's or independent laboratory fuel analysis while burning No.1 or No.2 fuel oil. The analysis must demonstrate that the No.1 or No.2 fuel oil is less than 1 pound/million Btu fired (ARM 17.8.1213).
- D.8. Montana-Dakota shall monitor compliance as required by 40 CFR 60, Subpart IIII (Standards of Performance for Stationary Compression Ignition Internal Combustion Engines) and 40 CFR 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines) (ARM 17.8.340).

Recordkeeping

- D.9. All compliance source test recordkeeping shall be performed in accordance with the test method used and the Montana Source Test Protocol and Procedures Manual, and shall be maintained on site (ARM 17.8.106 and ARM 17.8.1212).
- D.10. Montana-Dakota shall maintain a log on site to record the type of fuel used in the starting motor (ARM 17.8.1212).
- D.11. Montana-Dakota shall maintain on site a record of the fuel analyses provided by the fuel provider for the fuel types used during the previous 12-month period (ARM 17.8.1212).
- D.12. Montana-Dakota shall comply with all applicable standards, limitations and the reporting, recordkeeping, and notification requirements of 40 CFR 60, Subpart IIII (Standards of Performance for Stationary Compression Ignition Internal Combustion Engines) and 40 CFR 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines) (ARM 17.8.340).

Reporting

- D.13. Any compliance source test reports must be submitted in accordance with the Montana Source Test Protocol and Procedures Manual (ARM 17.8.106 and ARM 17.8.1212).
- D.14. The annual compliance certification required by Section V.B must contain a certification statement for the above applicable requirements (ARM 17.8.1212).

- D.15. The semiannual monitoring report shall provide (ARM 17.8.1212):
- a. A summary of results of any source testing that was performed during that semiannual period;
 - b. A summary of the log of the type of fuel used;
 - c. A summary of the record of the fuel analyses provided by the fuel provider or fuel analysis conducted by an independent laboratory as approved by the Department for the fuel types used during the previous 12-month period; and
 - d. A summary of any testing and reporting as may be applicable pursuant to 40 CFR 60, Subpart III and/or 40 CFR 63, Subpart ZZZZ

E. EU006: 2-MW Emergency Diesel Generator

Condition(s)	Pollutant/Parameter	Permit Limit	Compliance Demonstration		Reporting Requirements
			Method	Frequency	
E.1, E.5, E.9, E.12, E.13, E.14	Opacity	20%	Method 9	As required by the Department and Section III.A.1	Annual
E.2, E.6, E.9, E.12, E.13, E.14	Particulate from fuel combustion	$E = 1.026 * H^{-0.233}$	Method 5	As required by the Department and Section III.A.1	Semiannual
E.3, E.7, E.10, E.13, E.14	Hours of Operation	1000 hours per rolling 12-month period	Operating Log	Monthly	Semiannual
E.4, E.8, E.11, E.14	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ	40 CFR 60 Subpart III/40 CFR 63 Subpart ZZZZ

Conditions

- E.1. Montana-Dakota shall not cause or authorize emissions to be discharged into the outdoor atmosphere from any source that exhibits an opacity of 20% or greater averaged over 6 consecutive minutes (ARM 17.8.340(2)).
- E.2. Montana-Dakota shall not cause or authorize particulate matter caused by the combustion of fuel to be discharged from any stack or chimney into the outdoor atmosphere in excess of $E = 1.026 * H^{-0.233}$ for existing fuel burning equipment, where H = heat input capacity in MMBtu/hr and E = maximum allowable emission rate in lb/MMBtu (ARM 17.8.309).
- E.3. Montana-Dakota shall operate the diesel-powered emergency generator no more than 1000 hours per rolling 12-month period (ARM 17.8.749).
- E.4. Montana-Dakota shall comply with all applicable standards, limitations and the reporting, recordkeeping, and notification requirements of 40 CFR 60, Subpart III (Standards of Performance for Stationary Compression Ignition Internal Combustion Engines) and 40 CFR 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines) (ARM 17.8.340).

Compliance Demonstration

- E.5. As required by the Department and Section III.A.1, Montana-Dakota shall perform a Method 9 test in accordance with the Montana Source Test Protocol and Procedures Manual (ARM 17.8.106 and ARM 17.8.1213).
- E.6. As required by the Department and Section III.A.1, Montana-Dakota shall perform a Method 5 in accordance with the Montana Source Test Protocol and Procedures Manual (ARM 17.8.106).
- E.7. Montana-Dakota shall document, by month, the hours of operation of the 2 MW diesel generator. By the 25th of each month, Montana-Dakota shall total the hours of operation from the diesel generator during the previous 12-months to verify compliance with the limitation in Section III.E.3. (ARM 17.8.1213).
- E.8. Montana-Dakota shall monitor compliance as required by 40 CFR 60, Subpart IIII (Standards of Performance for Stationary Compression Ignition Internal Combustion Engines) and 40 CFR 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines) (ARM 17.8.340, ARM 17.8.342, 40 CFR 60, Subpart IIII; and 40 CFR 63, Subpart ZZZZ)

Recordkeeping

- E.9. All source test recordkeeping shall be performed in accordance with the test method used and the Montana Source Test Protocol and Procedures Manual (ARM 17.8.106).
- E.10. Montana-Dakota shall maintain a log on site of the hours of operation of the emergency diesel generator as described in Section III.E.7 (ARM 17.8.1212).
- E.11. Montana-Dakota shall comply with all applicable standards, limitations and the reporting, recordkeeping, and notification requirements of 40 CFR 60, Subpart IIII (Standards of Performance for Stationary Compression Ignition Internal Combustion Engines) and 40 CFR 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines) (ARM 17.8.340, ARM 17.8.342, 40 CFR 60, Subpart IIII; and 40 CFR 63, Subpart ZZZZ)

Reporting

- E.12. All source test reports must be submitted to the Department in accordance with the Montana Source Test Protocol and Procedures Manual (ARM 17.8.106).
- E.13. The annual compliance certification required by Section V.B must contain a certification statement for the above applicable requirements (ARM 17.8.1212).
- E.14. The semiannual monitoring report shall provide (ARM 17.8.1212):
 - a. A summary of results of any source testing that was performed during that semiannual period;
 - b. A summary of the log of hours of operation of the generator; and
 - c. A summary of any testing and reporting as may be applicable pursuant to 40 CFR 60, Subpart IIII and/or 40 CFR 63, Subpart ZZZZ.

SECTION IV. NON-APPLICABLE REQUIREMENTS

Air Quality Administrative Rules of Montana (ARM) and Federal Regulations identified as not applicable to the facility or to a specific emissions unit at the time of the permit issuance are listed below (ARM 17.8.1214). The following list does not preclude the need to comply with any new requirements that may become applicable during the permit term.

A. Facility-Wide

The following table contains non-applicable requirements which are administered by the Air Resources Management Bureau of the Department of Environmental Quality.

State Rule Citation	Reason
ARM 17.8.335 - Maintenance of Air Pollution Control Equipment for Existing Aluminum Plants	The facility is not in this source category.
ARM 17.8.771 - Mercury Emission Standards for Mercury-Emitting Generating Units	
ARM 17.8.772 - Mercury Allowance Allocations Under Cap and Trade Budget	This rule applies only to the Department, EPA, and/or regional authorities.
ARM 17.8, Subchapter 16 - Emission Control Requirements for Oil and Gas Well Facilities Operating Prior to Issuance of a Montana Air Quality Permit	The facility is not in this source category.
ARM 17.8, Subchapter 17 - Registration of Air Contaminant Sources	

Federal Rule Citation	Reason
40 CFR 60, Subparts C, Ca, Cb 40 CFR 60, Subparts D, Da, Db, Dc 40 CFR 60, Subparts E-J 40 CFR 60, Subparts K, Ka, Kb 40 CFR 60, Subparts L-Z 40 CFR 60, Subparts AA-EE 40 CFR 60, Subparts HH 40 CFR 60, Subparts KK-NN 40 CFR 60, Subparts PP-XX 40 CFR 60, Subparts AAA-BBB 40 CFR 60, Subparts DDD 40 CFR 60, Subparts FFF-LLL 40 CFR 60, Subparts NNN-VVV 40 CFR 61, Subparts B-F 40 CFR 61, Subparts H-L 40 CFR 61, Subparts N-R 40 CFR 61, Subparts V-W 40 CFR 61, Subpart Y 40 CFR 61, Subpart BB 40 CFR 61, Subpart FF	These requirements are not applicable because the facility is not an affected source as defined in these regulations.

B. Emission Units

The permit application identified applicable requirements: non-applicable requirements for individual or specific emission units were not listed. The Department has listed all non-applicable requirements in Section IV.A, these requirements relate to each specific unit, as well as facility wide.

SECTION V. GENERAL PERMIT CONDITIONS

A. Compliance Requirements

ARM 17.8, Subchapter 12, Operating Permit Program §1210(2)(a)-(c)&(e), §1206(6)(c)&(b)

1. The permittee must comply with all conditions of the permit. Any noncompliance with the terms or conditions of the permit constitutes a violation of the Montana Clean Air Act, and may result in enforcement action, permit modification, revocation and reissuance, or termination, or denial of a permit renewal application under ARM Title 17, Chapter 8, Subchapter 12.
2. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or of a notification of planned changes or anticipated noncompliance does not stay any permit condition.
3. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of the permit. If appropriate, this factor may be considered as a mitigating factor in assessing a penalty for noncompliance with an applicable requirement if the source demonstrates that both the health, safety or environmental impacts of halting or reducing operations would be more serious than the impacts of continuing operations, and that such health, safety or environmental impacts were unforeseeable and could not have otherwise been avoided.
4. The permittee shall furnish to the Department, within a reasonable time set by the Department (not to be less than 15 days), any information that the Department may request in writing to determine whether cause exists for modifying, revoking and reissuing, or terminating the permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of those records that are required to be kept pursuant to the terms of the permit. This subsection does not impair or otherwise limit the right of the permittee to assert the confidentiality of the information requested by the Department, as provided in 75-2-105, MCA.
5. Any schedule of compliance for applicable requirements with which the source is not in compliance with at the time of permit issuance shall be supplemental to, and shall not sanction noncompliance with, the applicable requirements on which it was based.
6. For applicable requirements that will become effective during the permit term, the source shall meet such requirements on a timely basis unless a more detailed plan or schedule is required by the applicable requirement or the Department.

B. Certification Requirements

ARM 17.8, Subchapter 12, Operating Permit Program §1207 and §1213(7)(a)&(c)-(d)

1. Any application form, report, or compliance certification submitted pursuant to ARM Title 17, Chapter 8, Subchapter 12, shall contain certification by a responsible official of truth, accuracy and completeness. This certification and any other certification required under ARM Title 17, Chapter 8, Subchapter 12, shall state that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate and complete.

2. Compliance certifications shall be submitted by February 15 of each year, or more frequently if otherwise specified in an applicable requirement or elsewhere in the permit. Each certification must include the required information for the previous calendar year (i.e., January 1 – December 31).
3. Compliance certifications shall include the following:
 - a. The identification of each term or condition of the permit that is the basis of the certification;
 - b. The identification of the method(s) or other means used by the owner or operator for determining the status of compliance with each term and condition during the certification period, consistent with ARM 17.8.1212;
 - c. The status of compliance with each term and condition for the period covered by the certification, *including whether compliance during the period was continuous or intermittent* (based on the method or means identified in ARM 17.8.1213(7)(c)(ii), as described above); and
 - d. Such other facts as the Department may require to determine the compliance status of the source.
4. All compliance certifications must be submitted to the Environmental Protection Agency, as well as to the Department, at the addresses listed in the Notification Addresses Appendix of this permit.

C. Permit Shield

ARM 17.8, Subchapter 12, Operating Permit Program §1214(1)-(4)

1. The applicable requirements and non-federally enforceable requirements are included and specifically identified in this permit and the permit includes a precise summary of the requirements not applicable to the source. Compliance with the conditions of the permit shall be deemed compliance with any applicable requirements and any non-federally enforceable requirements as of the date of permit issuance.
2. The permit shield described in 1 above shall remain in effect during the appeal of any permit action (renewal, revision, reopening, or revocation and reissuance) to the Board of Environmental Review (Board), until such time as the Board renders its final decision.
3. Nothing in this permit alters or affects the following:
 - a. The provisions of Sec. 7603 of the FCAA, including the authority of the administrator under that section;
 - b. The liability of an owner or operator of a source for any violation of applicable requirements prior to or at the time of permit issuance;
 - c. The applicable requirements of the Acid Rain Program, consistent with Sec. 7651g(a) of the FCAA;
 - d. The ability of the administrator to obtain information from a source pursuant to Sec. 7414 of the FCAA;

- e. The ability of the Department to obtain information from a source pursuant to the Montana Clean Air Act, Title 75, Chapter 2, MCA;
 - f. The emergency powers of the Department under the Montana Clean Air Act, Title 75, Chapter 2, MCA; and
 - g. The ability of the Department to establish or revise requirements for the use of Reasonably Available Control Technology (RACT) as defined in ARM Title 17, Chapter 8. However, if the inclusion of a RACT into the permit pursuant to ARM Title 17, Chapter 8, Subchapter 12, is appealed to the Board, the permit shield, as it applies to the source's existing permit, shall remain in effect until such time as the Board has rendered its final decision.
4. Nothing in this permit alters or affects the ability of the Department to take enforcement action for a violation of an applicable requirement or permit term demonstrated pursuant to ARM 17.8.106, Source Testing Protocol.
 5. Pursuant to ARM 17.8.132, for the purpose of submitting a compliance certification, nothing in these rules shall preclude the use, including the exclusive use, of any credible evidence or information relevant to whether a source would have been in compliance. However, when compliance or noncompliance is demonstrated by a test or procedure provided by permit or other applicable requirements, the source shall then be presumed to be in compliance or noncompliance unless that presumption is overcome by other relevant credible evidence.
 6. The permit shield will not extend to minor permit modifications or changes not requiring a permit revision (see Sections I & J).
 7. The permit shield will extend to significant permit modifications and transfer or assignment of ownership (see Sections K & O).

D. Monitoring, Recordkeeping, and Reporting Requirements

ARM 17.8, Subchapter 12, Operating Permit Program §1212(2)&(3)

1. Unless otherwise provided in this permit, the permittee shall maintain compliance monitoring records that include the following information:
 - a. The date, place as defined in the permit, and time of sampling or measurement;
 - b. The date(s) analyses were performed;
 - c. The company or entity that performed the analyses;
 - d. The analytical techniques or methods used;
 - e. The results of such analyses; and
 - f. The operating conditions at the time of sampling or measurement.
2. The permittee shall retain records of all required monitoring data and support information for a period of at least 5 years from the date of the monitoring sample, measurement, report, or application. Support information includes all calibration and maintenance records and all

original strip-chart recordings for continuous monitoring instrumentation, and copies of all reports required by the permit. All monitoring data, support information, and required reports and summaries may be maintained in computerized form at the plant site if the information is made available to Department personnel upon request, which may be for either hard copies or computerized format. Strip-charts must be maintained in their original form at the plant site and shall be made available to Department personnel upon request.

3. The permittee shall submit to the Department, at the addresses located in the Notification Addresses Appendix of this permit, reports of any required monitoring by February 15 and August 15 of each year, or more frequently if otherwise specified in an applicable requirement or elsewhere in the permit. The monitoring report submitted on February 15 of each year must include the required monitoring information for the period of July 1 through December 31 of the previous year. The monitoring report submitted on August 15 of each year must include the required monitoring information for the period of January 1 through June 30 of the current year. All instances of deviations from the permit requirements must be clearly identified in such reports. All required reports must be certified by a responsible official, consistent with ARM 17.8.1207.

E. Prompt Deviation Reporting

ARM 17.8, Subchapter 12, Operating Permit Program §1212(3)(c)

The permittee shall promptly report deviations from permit requirements, including those attributable to upset conditions as defined in the permit, the probable cause of such deviations, and any corrective actions or preventive measures taken. To be considered prompt, deviations shall be reported to the Department within the following timeframes (unless otherwise specified in an applicable requirement):

1. For deviations which may result in emissions potentially in violation of permit limitations:
 - a. An initial phone notification (or faxed or electronic notification) describing the incident within 24 hours (or the next business day) of discovery; and,
 - b. A follow-up written, faxed, or electronic report within 30 days of discovery of the deviation that describes the probable cause of the reported deviation and any corrective actions or preventative measures taken.
2. For deviations attributable to malfunctions, deviations shall be reported to the Department in accordance with the malfunction reporting requirements under ARM 17.8.110; and
3. For all other deviations, deviations shall be reported to the Department via a written, faxed, or electronic report within 90 days of discovery (as determined through routine internal review by the permittee).

Prompt deviation reports do not need to be resubmitted with regular semiannual (or other routine) reports, but may be referenced by the date of submittal.

F. Emergency Provisions

ARM 17.8, Subchapter 12, Operating Permit Program §1201(13) and §1214(5), (6)&(8)

1. An “emergency” means any situation arising from sudden and reasonably unforeseeable events beyond the control of the source, including acts of God, which situation requires immediate corrective action to restore normal operation and causes the source to exceed a technology-based emission limitation under this permit due to the unavoidable increases in emissions

attributable to the emergency. An emergency shall not include noncompliance to the extent caused by improperly designed equipment, lack of reasonable preventive maintenance, careless or improper operation, or operator error.

2. An emergency constitutes an affirmative defense to an action brought for noncompliance with a technology-based emission limitation if the permittee demonstrates through properly signed, contemporaneous logs, or other relevant evidence, that:
 - a. An emergency occurred and the permittee can identify the cause(s) of the emergency;
 - b. The permitted facility was at the time being properly operated;
 - c. During the period of the emergency the permittee took all reasonable steps to minimize levels of emissions that exceeded the emission standards or other requirements in the permit; and
 - d. The permittee submitted notice of the emergency to the Department within 2 working days of the time when emission limitations were exceeded due to the emergency. This notice fulfills the requirements of ARM 17.8.1212(3)(c). This notice must contain a description of the emergency, any steps taken to mitigate emissions, and corrective actions taken.
3. These emergency provisions are in addition to any emergency, malfunction or upset provision contained in any applicable requirement.

G. Inspection and Entry

ARM 17.8, Subchapter 12, Operating Permit Program §1213(3)&(4)

1. Upon presentation of credentials and other requirements as may be required by law, the permittee shall allow the Department, the administrator, or an authorized representative (including an authorized contractor acting as a representative of the Department or the administrator) to perform the following:
 - a. Enter the premises where a source required to obtain a permit is located or emissions-related activity is conducted, or where records must be kept under the conditions of the permit;
 - b. Have access to and copy, at reasonable times, any records that must be kept under the conditions of the permit;
 - c. Inspect at reasonable times any facilities, emission units, equipment (including monitoring and air pollution control equipment), practices, or operations regulated or required under the permit; and
 - d. As authorized by the Montana Clean Air Act and rules promulgated thereunder, sample or monitor, at reasonable times, any substances or parameters at any location for the purpose of assuring compliance with the permit or applicable requirements.
2. The permittee shall inform the inspector of all workplace safety rules or requirements at the time of inspection. This section shall not limit in any manner the Department's statutory right of entry and inspection as provided for in 75-2-403, MCA.

H. Fee Payment

ARM 17.8, Subchapter 12, Operating Permit Program §1210(2)(f) and ARM 17.8, Subchapter 5, Air Quality Permit Application, Operation, and Open Burning Fees §505(3)-(5) (STATE ONLY)

1. The permittee must pay application and operating fees, pursuant to ARM Title 17, Chapter 8, Subchapter 5.
2. Annually, the Department shall provide the permittee with written notice of the amount of the fee and the basis for the fee assessment. The air quality operation fee is due 30 days after receipt of the notice, unless the fee assessment is appealed pursuant to ARM 17.8.511. If any portion of the fee is not appealed, that portion of the fee that is not appealed is due 30 days after receipt of the notice. Any remaining fee, which may be due after the completion of an appeal, is due immediately upon issuance of the Board's decision or upon completion of any judicial review of the Board's decision.
3. If the permittee fails to pay the required fee (or any required portion of an appealed fee) within 90 days of the due date of the fee, the Department may impose an additional assessment of 15% of the fee (or any required portion of an appealed fee) or \$100, whichever is greater, plus interest on the fee (or any required portion of an appealed fee), computed at the interest rate established under 15-31-510(3), MCA.

I. Minor Permit Modifications

ARM 17.8, Subchapter 12, Operating Permit Program §1226(3)&(11)

1. An application for a minor permit modification need only address in detail those portions of the permit application that require revision, updating, supplementation, or deletion, and may reference any required information that has been previously submitted.
2. The permit shield under ARM 17.8.1214 will not extend to any minor modifications processed pursuant to ARM 17.8.1226.

J. Changes Not Requiring Permit Revision

ARM 17.8, Subchapter 12, Operating Permit Program §1224(1)-(3), (5)&(6)

1. The permittee is authorized to make changes within the facility as described below, provided the following conditions are met:
 - a. The proposed changes do not require the permittee to obtain a Montana Air Quality Permit under ARM Title 17, Chapter 8, Subchapter 7;
 - b. The proposed changes are not modifications under Title I of the FCAA, or as defined in ARM Title 17, Chapter 8, Subchapters 8, 9, or 10;
 - c. The emissions resulting from the proposed changes do not exceed the emissions allowable under this permit, whether expressed as a rate of emissions or in total emissions;
 - d. The proposed changes do not alter permit terms that are necessary to enforce applicable emission limitations on emission units covered by the permit; and
 - e. The facility provides the administrator and the Department with written notification at least 7 days prior to making the proposed changes.

2. The permittee and the Department shall attach each notice provided pursuant to 1.e above to their respective copies of this permit.
3. Pursuant to the conditions above, the permittee is authorized to make Section 502(b)(10) changes, as defined in ARM 17.8.1201(30), without a permit revision. For each such change, the written notification required under 1.e above shall include a description of the change within the source, the date on which the change will occur, any change in emissions, and any permit term or condition that is no longer applicable as a result of the change.
4. The permittee may make a change not specifically addressed or prohibited by the permit terms and conditions without requiring a permit revision, provided the following conditions are met:
 - a. Each proposed change does not weaken the enforceability of any existing permit conditions;
 - b. The Department has not objected to such change;
 - c. Each proposed change meets all applicable requirements and does not violate any existing permit term or condition; and
 - d. The permittee provides contemporaneous written notice to the Department and the administrator of each change that is above the level for insignificant emission units as defined in ARM 17.8.1201(22) and 17.8.1206(3), and the written notice describes each such change, including the date of the change, any change in emissions, pollutants emitted, and any applicable requirement that would apply as a result of the change.
5. The permit shield authorized by ARM 17.8.1214 shall not apply to changes made pursuant to ARM 17.8.1224(3) and (5), but is applicable to terms and conditions that allow for increases and decreases in emissions pursuant to ARM 17.8.1224(4).

K. Significant Permit Modifications

ARM 17.8, Subchapter 12, Operating Permit Program §1227(1), (3)&(4)

1. The modification procedures set forth in 2 below must be used for any application requesting a significant modification of this permit. Significant modifications include the following:
 - a. Any permit modification that does not qualify as either a minor modification or as an administrative permit amendment;
 - b. Every significant change in existing permit monitoring terms or conditions;
 - c. Every relaxation of permit reporting or recordkeeping terms or conditions that limit the Department's ability to determine compliance with any applicable rule, consistent with the requirements of the rule; or
 - d. Any other change determined by the Department to be significant.

2. Significant modifications shall meet all requirements of ARM Title 17, Chapter 8, including those for applications, public participation, and review by affected states and the administrator, as they apply to permit issuance and renewal, except that an application for a significant permit modification need only address in detail those portions of the permit application that require revision, updating, supplementation or deletion.
3. The permit shield provided for in ARM 17.8.1214 shall extend to significant modifications.

L. Reopening for Cause

ARM 17.8, Subchapter 12, Operating Permit Program §1228(1)&(2)

This permit may be reopened and revised under the following circumstances:

1. Additional applicable requirements under the FCAA become applicable to the facility when the permit has a remaining term of 3 or more years. Reopening and revision of the permit shall be completed not later than 18 months after promulgation of the applicable requirement. No reopening is required under ARM 17.8.1228(1)(a) if the effective date of the applicable requirement is later than the date on which the permit is due to expire, unless the original permit or any of its terms or conditions have been extended pursuant to ARM 17.8.1220(12) or 17.8.1221(2);
2. Additional requirements (including excess emission requirements) become applicable to an affected source under the Acid Rain Program. Upon approval by the administrator, excess emission offset plans shall be deemed incorporated into the permit;
3. The Department or the administrator determines that the permit contains a material mistake or that inaccurate statements were made in establishing the emission standards or other terms or conditions of the permit; or
4. The administrator or the Department determines that the permit must be revised or revoked and reissued to ensure compliance with the applicable requirements.

M. Permit Expiration and Renewal

ARM 17.8, Subchapter 12, Operating Permit Program §1210(2)(g), §1220(11)&(12), and §1205(2)(d)

1. This permit is issued for a fixed term of 5 years.
2. Renewal of this permit is subject to the same procedural requirements that apply to permit issuance, including those for application, content, public participation, and affected state and administrator review.
3. Expiration of this permit terminates the permittee's right to operate unless a timely and administratively complete renewal application has been submitted consistent with ARM 17.8.1221 and 17.8.1205(2)(d). If a timely and administratively complete application has been submitted, all terms and conditions of the permit, including the application shield, remain in effect after the permit expires until the permit renewal has been issued or denied.
4. For renewal, the permittee shall submit a complete air quality operating permit application to the Department not later than 6 months prior to the expiration of this permit, unless otherwise specified. If necessary to ensure that the terms of the existing permit will not lapse before renewal, the Department may specify, in writing to the permittee, a longer time period for submission of the renewal application. Such written notification must be provided at least 1 year before the renewal application due date established in the existing permit.

N. Severability Clause

ARM 17.8, Subchapter 12, Operating Permit Program §1210(2)(i)&(l)

1. The administrative appeal or subsequent judicial review of the issuance by the Department of an initial permit under this subchapter shall not impair in any manner the underlying applicability of all applicable requirements, and such requirements continue to apply as if a final permit decision had not been reached by the Department.
2. If any provision of a permit is found to be invalid, all valid parts that are severable from the invalid part remain in effect. If a provision of a permit is invalid in one or more of its applications, the provision remains in effect in all valid applications that are severable from the invalid applications.

O. Transfer or Assignment of Ownership

ARM 17.8, Subchapter 12, Operating Permit Program §1225(2)&(4)

1. If an administrative permit amendment involves a change in ownership or operational control, the applicant must include in its request to the Department a written agreement containing a specific date for the transfer of permit responsibility, coverage and liability between the current and new permittee.
2. The permit shield provided for in ARM17.8.1214 shall not extend to administrative permit amendments.

P. Emissions Trading, Marketable Permits, Economic Incentives

ARM 17.8, Subchapter 12, Operating Permit Program §1226(2)

Notwithstanding ARM 17.8.1226(1) and (7), minor air quality operating permit modification procedures may be used for permit modifications involving the use of economic incentives, marketable permits, emissions trading, and other similar approaches, to the extent that such minor permit modification procedures are explicitly provided for in the Montana State Implementation Plan or in applicable requirements promulgated by the administrator.

Q. No Property Rights Conveyed

ARM 17.8, Subchapter 12, Operating Permit Program §1210(2)(d)

This permit does not convey any property rights of any sort, or any exclusive privilege.

R. Testing Requirements

ARM 17.8, Subchapter 1, General Provisions §105

The permittee shall comply with ARM 17.8.105.

S. Source Testing Protocol

ARM 17.8, Subchapter 1, General Provisions §106

The permittee shall comply with ARM 17.8.106.

T. Malfunctions

ARM 17.8, Subchapter 1, General Provisions §110

The permittee shall comply with ARM 17.8.110.

U. Circumvention

ARM 17.8, Subchapter 1, General Provisions §111

The permittee shall comply with ARM 17.8.111.

V. Motor Vehicles

ARM 17.8, Subchapter 3, Emission Standards §325

The permittee shall comply with ARM 17.8.325.

W. Annual Emissions Inventory

ARM 17.8, Subchapter 5, Air Quality Permit Application, Operation and Open Burning Fees §505 (STATE ONLY)

The permittee shall supply the Department with annual production and other information for all emission units necessary to calculate actual or estimated actual amount of air pollutants emitted during each calendar year. Information shall be gathered on a calendar-year basis and submitted to the Department by the date required in the emission inventory request, unless otherwise specified in this permit. Information shall be in the units required by the Department.

X. Open Burning

ARM 17.8, Subchapter 6, Open Burning §604, 605 and 606

The permittee shall comply with ARM 17.8.604, 605 and 606.

Y. Montana Air Quality Permits

ARM 17.8, Subchapter 7, Permit, Construction and Operation of Air Contaminant Sources §745 and 764 (ARM 17.8.745(1) and 764(1)(b) are STATE ENFORCEABLE ONLY until approval by the EPA as part of the SIP)

1. Except as specified, no person shall construct, install, modify or use any air contaminant source or stack associated with any source without first obtaining a permit from the Department or Board. A permit is not required for those sources or stacks as specified by ARM 17.8.744(1)(a)-(k).
2. The permittee shall comply with ARM 17.8.743, 744, 745, 748, and 764.
3. ARM 17.8.745(1) specifies de minimis changes as construction or changed conditions of operation at a facility holding a Montana Air Quality Permit (MAQP) issued under Chapter 8 that does not increase the facility's potential to emit by more than 5 tons per year of any pollutant, except (STATE ENFORCEABLE ONLY until approved by the EPA as part of the SIP):
 - a. Any construction or changed condition that would violate any condition in the facility's existing MAQP or any applicable rule contained in Chapter 8 is prohibited, except as provided in ARM 17.8.745(2);
 - b. Any construction or changed conditions of operation that would qualify as a major modification under Subchapters 8, 9 or 10 of Chapter 8;

- c. Any construction or changed condition of operation that would affect the plume rise or dispersion characteristic of emissions that would cause or contribute to a violation of an ambient air quality standard or ambient air increment as defined in ARM 17.8.804;
 - d. Any construction or improvement project with a potential to emit more than 5 tons per year may not be artificially split into smaller projects to avoid Montana Air Quality Permitting; or
 - e. Emission reductions obtained through offsetting within a facility are not included when determining the potential emission increase from construction or changed conditions of operation, unless such reductions are made federally enforceable.
4. Any facility making a de minimis change pursuant to ARM 17.8.745(1) shall notify the Department if the change would include a change in control equipment, stack height, stack diameter, stack gas temperature, source location or fuel specifications, or would result in an increase in source capacity above its permitted operation or the addition of a new emission unit. The notice must be submitted, in writing, 10 days prior to start up or use of the proposed de minimis change, or as soon as reasonably practicable in the event of an unanticipated circumstance causing the de minimis change, and must include the information requested in ARM 17.8.745(1) (STATE ENFORCEABLE ONLY until approval by the EPA as part of the SIP).

Z. National Emission Standard for Asbestos
40 CFR, Part 61, Subpart M

The permittee shall not conduct any asbestos abatement activities except in accordance with 40 CFR 61, Subpart M (National Emission Standard for Hazardous Air Pollutants for Asbestos).

AA. Asbestos
ARM 17.74, Subchapter 3, General Provisions and Subchapter 4, Fees

The permittee shall comply with ARM 17.74.301, *et seq.*, and ARM 17.74.401, *et seq.* (State only)

BB. Stratospheric Ozone Protection – Servicing of Motor Vehicle Air Conditioners
40 CFR, Part 82, Subpart B

If the permittee performs a service on motor vehicles and this service involves ozone-depleting substance/refrigerant in the motor vehicle air conditioner (MVAC), the permittee is subject to all the applicable requirements as specified in 40 CFR 82, Subpart B.

CC. Stratospheric Ozone Protection – Recycling and Emission Reductions
40 CFR, Part 82, Subpart F

The permittee shall comply with the standards for recycling and emission reductions in 40 CFR 82, Subpart F, except as provided for MVACs in Subpart B:

- 1. Persons opening appliances for maintenance, service, repair, or disposal must comply with the required practices pursuant to §82.156;
- 2. Equipment used during the maintenance, service, repair or disposal of appliances must comply with the standards for recycling and recovery equipment pursuant to §82.158;

3. Persons performing maintenance, service, repair or disposal of appliances must be certified by an approved technical certification program pursuant to §82.161;
4. Persons disposing of small appliances, MVACs and MVAC-like (as defined at §82.152) appliances must comply with recordkeeping requirements pursuant to §82.166;
5. Persons owning commercial or industrial process refrigeration equipment must comply with the leak repair requirements pursuant to §82.156; and
6. Owners/operators of appliances normally containing 50 or more pounds of refrigerant must keep records of refrigerant purchased and added to such appliances pursuant to §82.166.

DD. Emergency Episode Plan

The permittee shall comply with the requirements contained in Chapter 9.7 of the State of Montana Air Quality Control Implementation Plan.

Each major source emitting 100 tons per year located in a Priority I Air Quality Control Region, shall submit to the Department a legally enforceable Emergency Episode Action Plan (EEAP) that details how the source will curtail emissions during an air pollutant emergency episode. The industrial EEAP shall be in accordance with the Department's EEAP and shall be submitted according to a timetable developed by the Department, following Priority I reclassification.

EE. Definitions

Terms not otherwise defined in this permit or in the Definitions and Abbreviations Appendix of this permit, shall have the meaning assigned to them in the referenced regulations.

APPENDICES

Appendix A INSIGNIFICANT EMISSION UNITS

Disclaimer: The information in this appendix is not State or Federally enforceable, but is presented to assist Montana-Dakota, the permitting authority, inspectors, and the public.

Pursuant to ARM 17.8.1201(22)(a), an insignificant emission unit means any activity or emissions unit located within a source that: (i) has a potential to emit less than 5 tons per year of any regulated pollutant; (ii) has a potential to emit less than 500 pounds per year of lead; (iii) has a potential to emit less than 500 pounds per year of hazardous air pollutants listed pursuant to section 7412 (b) of the FCAA; and (iv) is not regulated by an applicable requirement, other than a generally applicable requirement that applies to all emission units subject to Subchapter 12.

List of Insignificant Activities:

The following table of insignificant sources and/or activities were provided by Montana-Dakota.

Emissions Unit ID	Description
IEU01	Fugitive emissions from in-plant vehicle traffic
IEU02	60 kilowatt emergency plant power supply diesel generator
IEU03	Natural gas fired liquid fuel heater
IEU04	74,000 gallon No. 1/No.2 turbine fuel oil storage
IEU05	200 gallon No.1/No.2 turbine starting engine diesel fuel tank
IEU06	1,250 gallon No.1/No.2 emergency generator diesel fuel tank

Appendix B DEFINITIONS and ABBREVIATIONS

"Act" means the Clean Air Act, as amended, 42 U.S. 7401, *et seq.*

"Administrative permit amendment" means an air quality operating permit revision that:

- (a) corrects typographical errors;
- (b) identifies a change in the name, address or phone number of any person identified in the air quality operating permit, or identifies a similar minor administrative change at the source;
- (c) requires more frequent monitoring or reporting by Montana-Dakota;
- (d) requires changes in monitoring or reporting requirements that the Department deems to be no less stringent than current monitoring or reporting requirements;
- (e) allows for a change in ownership or operational control of a source if the Department has determined that no other change in the air quality operating permit is necessary, consistent with ARM 17.8.1225; or
- (f) incorporates any other type of change which the Department has determined to be similar to those revisions set forth in (a)-(e), above.

"Applicable requirement" means all of the following as they apply to emission units in a source requiring an air quality operating permit (including requirements that have been promulgated or approved by the Department or the administrator through rule making at the time of issuance of the air quality operating permit, but have future-effective compliance dates, provided that such requirements apply to sources covered under the operating permit):

- (a) any standard, rule, or other requirement, including any requirement contained in a consent decree or judicial or administrative order entered into or issued by the Department, that is contained in the Montana state implementation plan approved or promulgated by the administrator through rule making under Title I of the FCAA;
- (b) any federally enforceable term, condition or other requirement of any Montana Air Quality Permit issued by the Department under Subchapters 7, 8, 9 and 10 of this chapter, or pursuant to regulations approved or promulgated through rule making under Title I of the FCAA, including parts C and D;
- (c) any standard or other requirement under Section 7411 of the FCAA, including Section 7411(d);
- (d) any standard or other requirement under Section 7412 of the FCAA, including any requirement concerning accident prevention under Section 7412(r)(7), but excluding the contents of any risk management plan required under Section 7412(r);
- (e) any standard or other requirement of the acid rain program under Title IV of the FCAA or regulations promulgated thereunder;
- (f) any requirements established pursuant to Section 7661c(b) or Section 7414(a)(3) of the FCAA;

- (g) any standard or other requirement governing solid waste incineration, under Section 7429 of the FCAA;
- (h) any standard or other requirement for consumer and commercial products, under Section 7511b(e) of the FCAA;
- (i) any standard or other requirement for tank vessels, under Section 7511b(f) of the FCAA;
- (j) any standard or other requirement of the regulations promulgated to protect stratospheric ozone under Title VI of the FCAA, unless the administrator determines that such requirements need not be contained in an air quality operating permit;
- (k) any national ambient air quality standard or increment or visibility requirement under part C of Title I of the FCAA, but only as it would apply to temporary sources permitted pursuant to Section 7661c(e) of the FCAA; or
- (l) any federally enforceable term or condition of any air quality open burning permit issued by the Department under Subchapter 6.

"Department" means the Montana Department of Environmental Quality.

"Emissions unit" means any part or activity of a stationary source that emits or has the potential to emit any regulated air pollutant or any pollutant listed under Section 7412(b) of the FCAA. This term is not meant to alter or affect the definition of the term "unit" for purposes of Title IV of the FCAA.

"FCAA" means the Federal Clean Air Act, as amended.

"Federally enforceable" means all limitations and conditions which are enforceable by the administrator, including those requirements developed pursuant to 40 CFR Parts 60 and 61, requirements within the Montana state implementation plan, and any permit requirement established pursuant to 40 CFR 52.21 or under regulations approved pursuant to 40 CFR 51, Subpart I, including operating permits issued under an EPA approved program that is incorporated into the Montana state implementation plan and expressly requires adherence to any permit issued under such program.

"Fugitive emissions" means those emissions which could not reasonably pass through a stack, chimney, vent, or other functionally equivalent opening.

"General air quality operating permit" or **"general permit"** means an air quality operating permit that meets the requirements of ARM 17.8.1222, covers multiple sources in a source category, and is issued in lieu of individual permits being issued to each source.

"Hazardous air pollutant" means any air pollutant listed as a hazardous air pollutant pursuant to Section 112(b) of the FCAA.

"Non-federally enforceable requirement" means the following as they apply to emission units in a source requiring an air quality operating permit:

- (a) any standard, rule, or other requirement, including any requirement contained in a consent decree, or judicial or administrative order entered into or issued by the Department, that is not contained in the Montana state implementation plan approved or promulgated by the administrator through rule making under Title I of the FCAA;

- (b) any term, condition or other requirement contained in any Montana Air Quality Permit issued by the Department under Subchapters 7, 8, 9 and 10 of this chapter that is not federally enforceable;
- (c) does not include any Montana ambient air quality standard contained in Subchapter 2 of this chapter.

"Permittee" means the owner or operator of any source subject to the permitting requirements of this subchapter, as provided in ARM 17.8.1204, that holds a valid air quality operating permit or has submitted a timely and complete permit application for issuance, renewal, amendment, or modification pursuant to this subchapter.

"Regulated air pollutant" means the following:

- (a) nitrogen oxides or any volatile organic compounds;
- (b) any pollutant for which a national ambient air quality standard has been promulgated;
- (c) any pollutant that is subject to any standard promulgated under Section 7411 of the FCAA;
- (d) any Class I or II substance subject to a standard promulgated under or established by Title VI of the FCAA; or
- (e) any pollutant subject to a standard or other requirement established or promulgated under Section 7412 of the FCAA, including but not limited to the following:
 - (i) any pollutant subject to requirements under Section 7412(j) of the FCAA. If the administrator fails to promulgate a standard by the date established in Section 7412(e) of the FCAA, any pollutant for which a subject source would be major shall be considered to be regulated on the date 18 months after the applicable date established in Section 7412(e) of the FCAA;
 - (ii) any pollutant for which the requirements of Section 7412(g)(2) of the FCAA have been met but only with respect to the individual source subject to Section 7412(g)(2) requirement.

"Responsible official" means one of the following:

- (a) For a corporation: a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation, or a duly authorized representative of such person if the representative is responsible for the overall operation of one or more manufacturing, production, or operating facilities applying for or subject to a permit and either:
 - (i) the facilities employ more than 250 persons or have gross annual sales or expenditures exceeding \$25 million (in second quarter 1980 dollars); or
 - (ii) the delegation of authority to such representative is approved in advance by the Department.

- (b) For a partnership or sole proprietorship: a general partner or the proprietor, respectively.
- (c) For a municipality, state, federal, or other public agency: either a principal executive officer or ranking elected official. For the purposes of this part, a principal executive officer of a federal agency includes the chief executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., a regional administrator of the environmental protection agency).
- (d) For affected sources: the designated representative in so far as actions, standards, requirements, or prohibitions under Title IV of the FCAA or the regulations promulgated thereunder are concerned, and the designated representative for any other purposes under this subchapter.

Abbreviations:

ARM	Administrative Rules of Montana
ASTM	American Society of Testing Materials
BACT	Best Available Control Technology
BDT	bone dry tons
BTU	British Thermal Unit
CFR	Code of Federal Regulations
CO	carbon monoxide
DEQ	Department of Environmental Quality
dscf	dry standard cubic foot
dscfm	dry standard cubic foot per minute
EEAP	Emergency Episode Action Plan
EPA	U.S. Environmental Protection Agency
EPA Method	Test methods contained in 40 CFR 60, Appendix A
EU	emissions unit
FCAA	Federal Clean Air Act
gr	grains
HAP	hazardous air pollutant
IEU	insignificant emissions unit
Mbdft	thousand board feet
Method 5	40 CFR 60, Appendix A, Method 5
Method 9	40 CFR 60, Appendix A, Method 9
MMbdft	million board feet
MMBTU	million British Thermal Units
NO _x	oxides of nitrogen
NO ₂	nitrogen dioxide
O ₂	oxygen
Pb	lead
PM	particulate matter
PM10	particulate matter less than 10 microns in size
psi	pounds per square inch
scf	standard cubic feet
SIC	Source Industrial Classification
SO ₂	sulfur dioxide
SO _x	oxides of sulfur
tpy	tons per year
U.S.C.	United States Code
VE	visible emissions
VOC	volatile organic compound

Appendix C NOTIFICATION ADDRESSES

Compliance Notifications:

Montana Department of Environmental Quality
Permitting and Compliance Division
Air Resources Management Bureau
P.O. Box 200901
Helena, MT 59620-0901

United States EPA
Air Program Coordinator
Region VIII, Montana Office
10 W. 15th Street, Suite 3200
Helena, MT 59626

Permit Modifications:


Montana Department of Environmental Quality
Permitting and Compliance Division
Air Resources Management Bureau
P.O. Box 200901
Helena, MT 59620-0901

Office of Partnerships and Regulatory Assistance
Air and Radiation Program
US EPA Region VIII 8P-AR
1595 Wynkoop Street
Denver, CO 80202-1129

Appendix D AIR QUALITY INSPECTOR INFORMATION

Disclaimer: The information in this appendix is not State or Federally enforceable, but is presented to assist Montana-Dakota, permitting authority, inspectors, and the public.

- 1. Direction to Plant:** Located approximately 4 miles south of Glendive, Montana. The generating station is bordered on the west by Marsh Road.
- 2. Safety Equipment Required:** Hard hat, steel-toed shoes/boots, safety glasses with side shields, and hearing protection (ear plugs will be provided by Montana-Dakota) are required at the facility. A detailed safety manual is available at the site, and an Montana-Dakota employee will conduct a safety briefing for any inspector prior to entering the plant area.
- 3. Facility Plot Plan:** The facility plot plan was submitted as part of the application on 2/24/2010 and is presented on the following page.

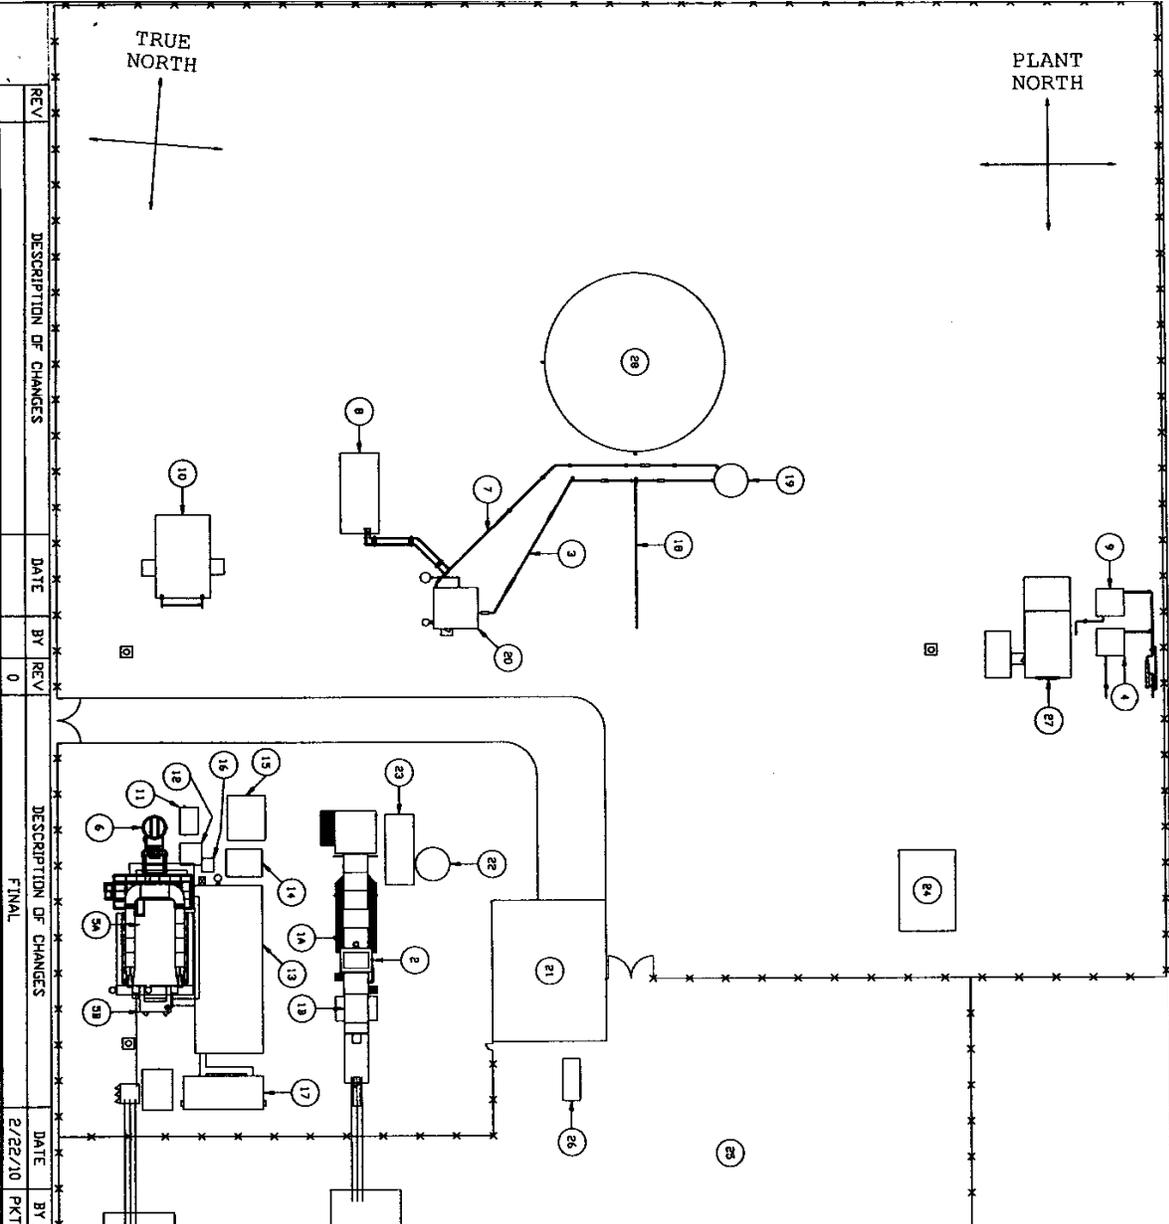

REV	DESCRIPTION OF CHANGES	DATE	BY	REV	DESCRIPTION OF CHANGES	DATE	BY
0	FINAL	2/22/10	PKT	1	SHEET 1 OF 1		SCALE: N/A

<p>GLENDIVE COMBUSTION TURBINE PLANT UNITS #1 & #2 GENERAL LAYOUT DRAWING OVERALL PLANT SITE LAYOUT</p>	
NAME: MDU851G.100	
DATE: 2/17/2010	
By: PKT	

 <p>Glendive Combustion Turbine Plant</p>	<p>Units #1 & #2</p>
--	--------------------------

BUILDINGS & STRUCTURES:

- UNIT 1: COMBUSTION TURBINE (A) & GENERATOR (B) PACKAGE
- UNIT 1: PRIMARY EXHAUST STACK
- UNIT 1: FUEL OIL SYSTEM (ABOVE GROUND)
- UNIT 1: NATURAL GAS METERING & REGULATING BUILDING
- UNIT 2: COMBUSTION TURBINE (A) & GENERATOR (B) PACKAGE
- UNIT 2: PRIMARY EXHAUST STACK
- UNIT 2: FUEL OIL SYSTEM (ABOVE GROUND)
- UNIT 2: FUEL OIL HEATER
- UNIT 2: NATURAL GAS METERING & REGULATING BUILDING
- UNIT 2: NATURAL GAS FUEL COMPRESSOR
- UNIT 2: NATURAL GAS CHROMATOGRAPH & FINAL COALESCING FILTER
- UNIT 2: PURGE SEPARATOR SKID & BUILDING
- UNIT 2: AUXILIARIES BUILDING
- UNIT 2: FIN FAN LUBE OIL COOLER
- UNIT 2: NIAGARA SKID AND BUILDING
- UNIT 2: WASTE TANK
- UNIT 2: POWER CONTROL MODULE
- COMMON: FUEL OIL LOADING/OFFLOADING SYSTEM (ABOVE GROUND)
- COMMON: FUEL OIL STORAGE TANK
- COMMON: FUEL OIL FORWARDING BUILDING
- COMMON: PRIMARY CONTROL ROOM - OFFICES - SHOP
- COMMON: DEMINERALIZED WATER STORAGE TANK
- COMMON: DEMINERALIZED WATER TREATMENT & PUMPING BUILDING
- COMMON: COLD STORAGE BUILDING
- COMMON: SUBSTATION
- COMMON: EMERGENCY GENERATOR
- OBsolete: UNIT 2: NATURAL GAS FUEL COMPRESSOR
- OBsolete: COMMON: STORAGE TANK

Appendix E ACID RAIN



United States
Environmental Protection Agency
Acid Rain Program

OMB No. 2060-0258
RECEIVED

Phase II Permit Application

MAR 01 2002 Page 1


For more information, see instructions and refer to 40 CFR 72.30 and 72.31

This submission is: New Revised

Michigan Department of
Environmental Quality
Permitting and Compliance Division
Attn: [unclear]

STEP 1
Identify the source by
plant name, State, and
ORIS code.

Plant Name	State	ORIS Code
Glendive Generating Station	MT	02176

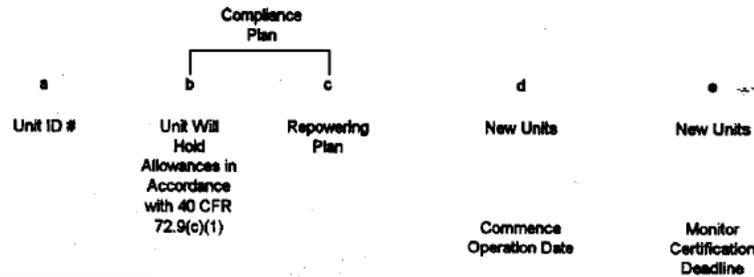

STEP 2
Enter the unit ID # for each affected unit, and indicate whether the unit is being repowered and the repowering plan being renewed by entering "yes" or "no" at column c. For new units, enter the requested information in columns d and e.

a	b	c	d	e
Unit ID #	Unit Will Hold Allowances in Accordance with 40 CFR 72.9(c)(1)	Repowering Plan	New Units Commence Operation Date	New Units Monitor Certification Deadline
GT-2	Yes	No	6/1/2002	
	Yes			

STEP 3
Check the box if the response in column c of Step 2 is "Yes" for any unit.

For each unit that is being repowered, the Repowering Extension Plan form is included.

EPA Form 7610-16 (rev. 4-98)
ITP 000525P 1

Plant Name (from Step 1)
Glendive Generating Station

Step 4
Read the standard requirements and certification, enter the name of the designated representative, and sign and date

Standard Requirements

Phase II Permit - Page 2

Permit Requirements

- (1) The designated representative of each affected source and each affected unit at the source shall:
 - (i) Submit a complete Acid Rain permit application (including a compliance plan) under 40 CFR part 72 in accordance with the deadlines specified in 40 CFR 72.30; and
 - (ii) Submit in a timely manner any supplemental information that the permitting authority determines is necessary in order to review an Acid Rain permit application and issue or deny an Acid Rain permit;
- (2) The owners and operators of each affected source and each affected unit at the source shall:
 - (i) Operate the unit in compliance with a complete Acid Rain permit application or a superseding Acid Rain permit issued by the permitting authority; and
 - (ii) Have an Acid Rain Permit.

Monitoring Requirements

- (1) The owners and operators and, to the extent applicable, designated representative of each affected source and each affected unit at the source shall comply with the monitoring requirements as provided in 40 CFR part 75.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR part 75 shall be used to determine compliance by the unit with the Acid Rain emissions limitations and emissions reduction requirements for sulfur dioxide and nitrogen oxides under the Acid Rain Program.
- (3) The requirements of 40 CFR part 75 shall not affect the responsibility of the owners and operators to monitor emissions of other pollutants or other emissions characteristics at the unit under other applicable requirements of the Act and other provisions of the operating permit for the source.

Sulfur Dioxide Requirements

- (1) The owners and operators of each source and each affected unit at the source shall:
 - (i) Hold allowances, as of the allowance transfer deadline, in the unit's compliance subaccount (after deductions under 40 CFR 73.34(c)) not less than the total annual emissions of sulfur dioxide for the previous calendar year from the unit; and
 - (ii) Comply with the applicable Acid Rain emissions limitations for sulfur dioxide.
- (2) Each ton of sulfur dioxide emitted in excess of the Acid Rain emissions limitations for sulfur dioxide shall constitute a separate violation of the Act.
- (3) An affected unit shall be subject to the requirements under paragraph (1) of the sulfur dioxide requirements as follows:
 - (i) Starting January 1, 2000, an affected unit under 40 CFR 72.6(a)(2); or
 - (ii) Starting on the later of January 1, 2000 or the deadline for monitor certification under 40 CFR part 75, an affected unit under 40 CFR 72.6(a)(3).
- (4) Allowances shall be held in, deducted from, or transferred among Allowance Tracking System accounts in accordance with the Acid Rain Program.
- (5) An allowance shall not be deducted in order to comply with the requirements under paragraph (1) of the sulfur dioxide requirements prior to the calendar year for which the allowance was allocated.
- (6) An allowance allocated by the Administrator under the Acid Rain Program is a limited authorization to emit sulfur dioxide in accordance with the Acid Rain Program. No provision of the Acid Rain Program, the Acid Rain permit application, the Acid Rain permit, or an exemption under 40 CFR 72.7-72.8 or 72.14 and no provision of law shall be construed to limit the authority of the United States to terminate or limit such authorization.
- (7) An allowance allocated by the Administrator under the Acid Rain Program does not constitute a property right.

Nitrogen Oxides Requirements. The owners and operators of the source and each affected unit at the source shall comply with the applicable Acid Rain emissions limitation for nitrogen oxides.

Excess Emissions Requirements

- (1) The designated representative of an affected unit that has excess emissions in any calendar year shall submit a proposed offset plan, as required under 40 CFR part 77.
- (2) The owners and operators of an affected unit that has excess emissions in any calendar year shall:
 - (i) Pay without demand the penalty required, and pay upon demand the interest on that penalty, as required by 40 CFR part 77; and
 - (ii) Comply with the terms of an approved offset plan, as required by 40 CFR part 77.

Recordkeeping and Reporting Requirements

- (1) Unless otherwise provided, the owners and operators of the source and each affected unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time prior to the end of 5 years, in writing by the Administrator or permitting authority:
 - (i) The certificate of representation for the designated representative for the source and each affected unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation, in accordance with 40 CFR 72.24; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation changing the designated representative;
 - (ii) All emissions monitoring information, in accordance with 40 CFR part 75, provided that to the extent that 40 CFR part 75 provides for a 3-year period for recordkeeping, the 3-year period shall apply.
 - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the Acid Rain Program; and,
 - (iv) Copies of all documents used to complete an Acid Rain permit application and any other submission under the Acid Rain Program or to demonstrate compliance with the requirements of the Acid Rain Program.
- (2) The designated representative of an affected source and each affected unit at the source shall submit the reports and compliance certifications required under the Acid Rain Program, including those under 40 CFR part 72 subpart I and 40 CFR part 75.

Plant Name (from Step 1)

Glendive Generating Station

Liability

- (1) Any person who knowingly violates any requirement or prohibition of the Acid Rain Program, a complete Acid Rain permit application, an Acid Rain permit, or an exemption under 40 CFR 72.7, 72.8, or 72.14, including any requirement for the payment of any penalty owed to the United States, shall be subject to enforcement pursuant to section 113(c) of the Act.
- (2) Any person who knowingly makes a false, material statement in any record, submission, or report under the Acid Rain Program shall be subject to criminal enforcement pursuant to section 113(c) of the Act and 18 U.S.C. 1001.
- (3) No permit revision shall excuse any violation of the requirements of the Acid Rain Program that occurs prior to the date that the revision takes effect.
- (4) Each affected source and each affected unit shall meet the requirements of the Acid Rain Program.
- (5) Any provision of the Acid Rain Program that applies to an affected source (including a provision applicable to the designated representative of an affected source) shall also apply to the owners and operators of such source and of the affected units at the source.
- (6) Any provision of the Acid Rain Program that applies to an affected unit (including a provision applicable to the designated representative of an affected unit) shall also apply to the owners and operators of such unit. Except as provided under 40 CFR 72.44 (Phase II repowering extension plans) and 40 CFR 78.11 (NO_x averaging plans), and except with regard to the requirements applicable to units with a common stack under 40 CFR part 75 (including 40 CFR 75.16, 75.17, and 75.18), the owners and operators and the designated representative of one affected unit shall not be liable for any violation by any other affected unit of which they are not owners or operators or the designated representative and that is located at a source of which they are not owners or operators or the designated representative.
- (7) Each violation of a provision of 40 CFR parts 72, 73, 74, 75, 76, 77, and 78 by an affected source or affected unit, or by an owner or operator or designated representative of such source or unit, shall be a separate violation of the Act.

Effect on Other Authorities. No provision of the Acid Rain Program, an Acid Rain permit application, an Acid Rain permit, or an exemption under 40 CFR 72.7, 72.8, or 72.14 shall be construed as:

- (1) Except as expressly provided in title IV of the Act, exempting or excluding the owners and operators and, to the extent applicable, the designated representative of an affected source or affected unit from compliance with any other provision of the Act, including the provisions of title I of the Act relating to applicable National Ambient Air Quality Standards or State Implementation Plans;
- (2) Limiting the number of allowances a unit can hold; provided, that the number of allowances held by the unit shall not affect the source's obligation to comply with any other provisions of the Act;
- (3) Requiring a change of any kind in any State law regulating electric utility rates and charges, affecting any State law regarding such State regulation, or limiting such State regulation, including any prudence review requirements under such State law;
- (4) Modifying the Federal Power Act or affecting the authority of the Federal Energy Regulatory Commission under the Federal Power Act; or,
- (5) Interfering with or impairing any program for competitive bidding for power supply in a State in which such program is established.

Certification

I am authorized to make this submission on behalf of the owners and operators of the affected source or affected units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name Bruce Imsdahl	
Signature <i>Bruce Imsdahl</i>	Date 3/2/01

Appendix F NO_x PEMS/CEMS

Nothing in this appendix is intended to alter the requirements in the Acid Rain Appendix.

1. Pursuant to 40 CFR Part 75, Montana-Dakota shall calibrate, maintain, and operate continuous monitoring systems or predictive emissions monitoring systems.

The monitoring systems shall be capable of determining emissions in the units of the applicable standards.

Except for system breakdowns, repairs, calibration checks, and zero and span adjustments required pursuant to 40 CFR Part 75, all continuous monitoring systems and predictive emissions monitoring systems shall be in continuous operation.

2. Compliance with 40 CFR Part 75 shall be deemed compliance with the requirements contained in 40 CFR §60.13(a) through (c), (e) through (g), and (i) through (j).
3. Montana-Dakota shall determine the gross calorific value (GCV) of the fuels using methods as identified in 40 CFR Part 75, Appendix F, §3.3.6.2, at a minimum of once per year for each fuel used.
4. Montana-Dakota shall conduct fuel analyses per the required methods in 40 CFR 75, Appendix F §3.3.6.1, or other method approved by the Department.
5. Montana-Dakota shall maintain records for a minimum of five years of the log sheets, computerized data, analysis, and calculations used to prepare the required reports.
6. Montana-Dakota shall submit reports to the Department containing the information required by 40 CFR §60.7 and as required below. All reports shall be required semiannually for each 6-month period.
 - a. Montana-Dakota shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of an affected facility; any malfunction of the air pollution control equipment; or any periods during which the continuous monitoring system or predictive emission monitoring system is inoperative.
 - b. Montana-Dakota shall submit an excess emissions and monitoring systems performance report and/or a summary report form (see paragraph (c) below) to the Department. Written reports of excess emissions shall be reported in the units of the standard exceeded and shall include the following information:
 - i. The magnitude of excess emissions, any conversion factor(s) used, the date and time of commencement and completion of each time period of excess emissions, and the process operating time during the reporting period.
 - ii. Specific identification of each period of excess emissions that occurs during startups, shutdowns, and malfunctions of the affected facility. The nature and cause of any malfunction (if known), the corrective action taken or preventative measures adopted.
 - iii. The date and time identifying each period during which the continuous or predictive monitoring system was inoperative except for zero and span checks, and the nature of the system repairs or adjustments.

- iv. When no excess emissions have occurred, or the continuous or predictive monitoring system(s) have not been inoperative, repaired, or adjusted, such information shall be stated in the report.
- c. The summary report form shall contain the information and be in the format shown in Figure 1. The summary report form shall be submitted as follows:
 - i. If the total duration of excess emissions for the reporting period is less than 1 percent of the total operating time for the reporting period and CEMS or PEMS downtime for the reporting period is less than 5 percent of the total operating time for the reporting period, only the summary report form shall be submitted and the excess emission report described in section (b) above need not be submitted unless requested.
 - ii. If the total duration of excess emissions for the reporting period is 1 percent or greater of the total operating time for the reporting period or the total CEMS or PEMS downtime for the reporting period is 5 percent or greater of the total operating time for the reporting period, the summary report form and the excess emission report described in section (b) above shall both be submitted.

Figure 1--Summary Report--Gaseous Excess Emission and Monitoring System Performance

Pollutant:
Reporting period dates: From _____ to _____
Emission Limitation:
Monitor Manufacturer and Model No.:
Date of Latest CEMS or PEMS Certification or Audit:
Process Unit(s) Description:
Total source operating time in reporting period:

Emission Data Summary

1. Duration of excess emission in reporting period due to:
 - a. Startup/shutdown.
 - b. Control equipment problems.
 - c. Process problems.
 - d. Other known causes.
 - e. Unknown causes.
2. Total duration of excess emissions.
3. $\frac{\text{Total duration of excess emissions} \times (100)}{\text{Total Operating Time}} = \% \text{ excess emissions}$

CEMS/PEMS Performance Summary

1. CEMS/PEMS downtime in reporting period due to:
 - a. Monitor equipment malfunctions.
 - b. Non-Monitor equipment malfunctions.
 - c. Quality assurance calibrations.
 - d. Other known causes.
 - e. Unknown causes.
2. Total CEMS/PEMS Downtime (nearest quarter hour).
3. $\frac{\text{Total CEMS/PEMS downtime}}{\text{Total operating time}} = \% \text{ downtime}$
4. Total operating time (nearest quarter hour).

The semiannual reports must be received by the Department on or before February 15 and August 15.

7. While operating PEMS, Montana-Dakota shall retest the NO_x emission rate of the gas-fired peaking unit or the oil-fired peaking unit while combusting each type of fuel (or fuel mixture) for which a NO_x emission rate versus heat input rate correlation curve was derived, at least once every 20 calendar quarters. If a required retest is not completed by the end of the 20th calendar quarter following the quarter of the last test, Montana-Dakota shall use the missing data substitution procedures in 40 CFR 75, Appendix E, Section 2.5, beginning with the first unit operating hour after the end of the 20th calendar quarter. Montana-Dakota shall continue using the missing data substitution procedures until the required retest has been passed. Note that missing data substitution is fuel-specific (i.e., the use of substitute data is required only when combusting a fuel (or fuel mixture) for which the retesting deadline has not been met). Each time that a new fuel-specific correlation curve is derived from retesting, the new curve shall be used to report NO_x emission rate, beginning with the first operating hour in which the fuel is combusted, following the completion of the retest.