



September

2022



Residential Buildings Energy Code Summary



Overview

Montana homebuyers appreciate the comfort and warmth of a well-designed energy-efficient home. All new houses in Montana must meet the minimum requirements of the 2021 International Energy Conservation Code (2021 IECC) with Montana amendments. This publication is a summary of the 2021 IECC residential provisions with Montana amendments. A copy of the 2021 IECC can be ordered from the International Code Council at www.iccsafe.org or by calling 800-786-4452. For more information regarding the Montana Energy Code please call the Montana Department of Environmental Quality at 406-444-0281 or visit <https://www.deq.mt.gov/energy>. The 2021 IECC, with Montana amendments, took effect on June 10, 2022. Certified jurisdictions may take up to 90 days from their notification date to adopt the code.

Cities, towns, and counties who choose to adopt the building code are required to enforce the state energy code in their jurisdictions. A listing of certified jurisdictions that have adopted building codes is available at www.buildingcodes.mt.gov. Outside of these building code jurisdictions, builders are required to meet the requirements of the energy code and to show energy code compliance through a self-certification process. This means the builder is required to provide a written statement to the homeowner stating the house meets the state energy code requirements. The home builder may provide this certification by signing and dating the Energy Code Compliance label as shown on page 15 of this document.

Below are significant changes in the Montana energy code explained in more detail in this document:

- Mechanical ventilation systems (bath and kitchen exhaust fans) are required to pass an air flow test.
- All permanent light fixtures must be high-efficacy lighting sources.
- Blower door test has a new option making it easier for small houses to pass the blower door test.
- One additional energy efficiency feature is required.

The statewide energy code gives house buyers an additional tool to use in making their purchase decision. The Energy Code Compliance Label is required in all new residential construction and is a way for the builder to certify the house meets the minimum code levels for insulation, window, and heating system efficiencies and other energy features required in new residential construction. The label also ensures the information about these features is not lost over time. The label should be permanently affixed to the house's electrical breaker box, so subsequent owners will have the same information available to them.

Not only do home builders and home buyers benefit from this code, but Montana wins too. Energy efficient homes consume less energy than homes not built to meet the energy code. Less energy must be produced to heat and cool energy-efficient homes which helps conserve Montana's fossil fuel resources and protects our environment.

What Buildings are Covered Under the Statewide Energy Code?

The energy code applies to all new residential buildings, additions, repairs, and renovations in Montana (with exceptions noted below) regardless of fuel type (gas, electricity or other). Unaltered portions of existing buildings do not need to comply with this code. Residential buildings (R-2, R-3, and R-4) with more than three floors above ground must comply with the commercial energy code portions of the 2021 IECC.

The following buildings are exempt from this code:

- Farm and ranch buildings, any private garage or private storage structure attached to a home, buildings that are classified or determined to be eligible for a listing in the National Register of Historic Places, and Housing and Urban Development (HUD) code manufactured homes.
- Low energy use buildings or portions of a building which have a peak design rate energy use of less than 3.4 Btu/h per square foot of floor area for space conditioning (heating and cooling) are only exempt from the building thermal envelope provisions of the code.
- Log homes must follow ICC-400 requirements.

Ways to Show Energy Code Compliance

There are two primary ways to demonstrate the thermal envelope of one- and two-family dwellings meet the requirements of the Montana Energy Code (2021 International Energy Conservation Code with Montana amendments).

- Follow the prescriptive path listed below in Table 1
- Use REScheck™, a computer analysis, to show compliance
 - A free download of REScheck™ is available at www.energycodes.gov
 - REScheck™ requires inputs of the areas and insulation efficiency levels for ceilings, walls, and windows

Table 1 – Insulation and Window Requirements by Component

Component	Insulation or Efficiency Level*
Ceiling	R-49/38 ^A
Exterior Wall	R-21 or R13+R10 CI ^B
Mass Wall	R15/20 ^C
Floor	R-30 ^D
Basement Wall	R-19/15 CI ^E
Slab Perimeter	R-10, ^F from top edge for 4 ft.
Crawlspace Wall	R-19/15 CI ^G
Window/Door U	U -.30 ^H
Skylight	U-.55
*Contain some Montana Amendments	

The R-value requirement listings are for insulation material only, not for structural components such as drywall or siding. All materials, systems, and equipment must be installed in accordance with the manufacturer's installation instructions.

- A. R-38 is acceptable if the full height of uncompressed R-38 insulation extends over the wall top plate at the eaves. See figure 4, page 11.
 - a. Where there is not enough space to achieve Table 1 ceiling insulation levels, R-30 is allowed in up to 250 sq. ft. or 10 percent of the space, whichever is less.
 - b. Insulation markers with at least one-inch sized numbers are required at least every 300-sq. ft. of attic space and must face the access opening.
 - c. Attic access hatches and doors must be weather-stripped or sealed and baffled to prevent loose insulation from spilling into the living space and insulated to its surrounding area's requirement. Vertical access doors to unconditioned spaces must have at least a U-factor of .30, approximately R-3.
- B. The second number is a listing for continuous Insulation (CI), which is insulation that runs continuously over structural members and is free of thermal bridging. Foam sheathing over exterior wall framing is an example of continuous insulation.

Table 2 – R402.26 Requirement for Steel-Frame Wall (R-Value)

Steel-Framed Wall 16" O.C. – R-13 + 9.5 or R-15 + 9.1 or R-19 + 8.4 or R-21 + 8.1
Steel-Framed Wall 24" O.C. – R-13 + 8.3 or R-15 + 7.7 or R-19 + 6.9 or R-21 + 6.5
Cavity insulation R-value is listed first, followed by continuous insulation R-value.

Structural Insulated Panels (SIP) with at least 5.5 inches of foam and insulated concrete foam systems (ICF) with at least 2 inches of foam on each side, usually surpass the R-21 wall requirements because of their lack of thermal bridging. A REScheck™ analysis can be used to show compliance.


- C. Mass walls are above grade walls of concrete, concrete block, insulated concrete forms (ICF), brick, (other than brick veneer), earth. R-20 applies when more than half the insulation is on the interior of the mass wall. **Log walls must comply with ICC 400 requirements.**
- D. Floor insulation must be in contact with the underside of the floor sheathing.
- E. Basement walls, whether the space is finished or not, require R-19 cavity or R-15 continuous insulation level.
- F. Heated slab-on-grade includes floors with heating elements, hydronic tubing, and ductwork within or under the slab and require R-5 under the entire slab floor. Slab-on-grade floors with a floor surface less than 12 inches below grade require R-10 insulation. Slab-on-grade insulation should extend downward from the top of the slab on the outside or inside of the foundation wall. The insulation should extend 4 feet by any combination of vertical and horizontal placement that extends out from the slab or under the slab (see the Insulated Slab Options, figure 1). Insulation extending away from the building must be protected by pavement or at least 10 inches of soil. The top edge of the insulation installed between the exterior wall and the edge of the interior slab may be cut at a 45-degree angle. Exposed insulation shall have a weather-resistant protective covering extending at least 6 inches below grade level. R-5 is required under entire floor of heated slabs.
- G. Unvented crawlspace walls require a minimum of R-19 cavity or R-15 continuous insulation. Insulation must cover the entire foundation wall.
- H. Because the U-factor is the inverse of the R-value, a lower U-factor indicates a window that has better thermal capabilities than a window with a higher U-value. Example: A U-.30 rated window is more efficient than a U-.32 rated window. Up to 15 sq. ft. of glazing and one side hinged door up to 24 sq. ft. is exempt from the U-factor requirements. Skylights must have a U-factor of at least .55.

Insulated Slab Options


Slab perimeter insulation of at least R-10 from the top edge for at least 4 feet. At least R-5 required under entire area of a heated slab-on-grade and recommended under all heated slabs.

Figure 1

Option 1

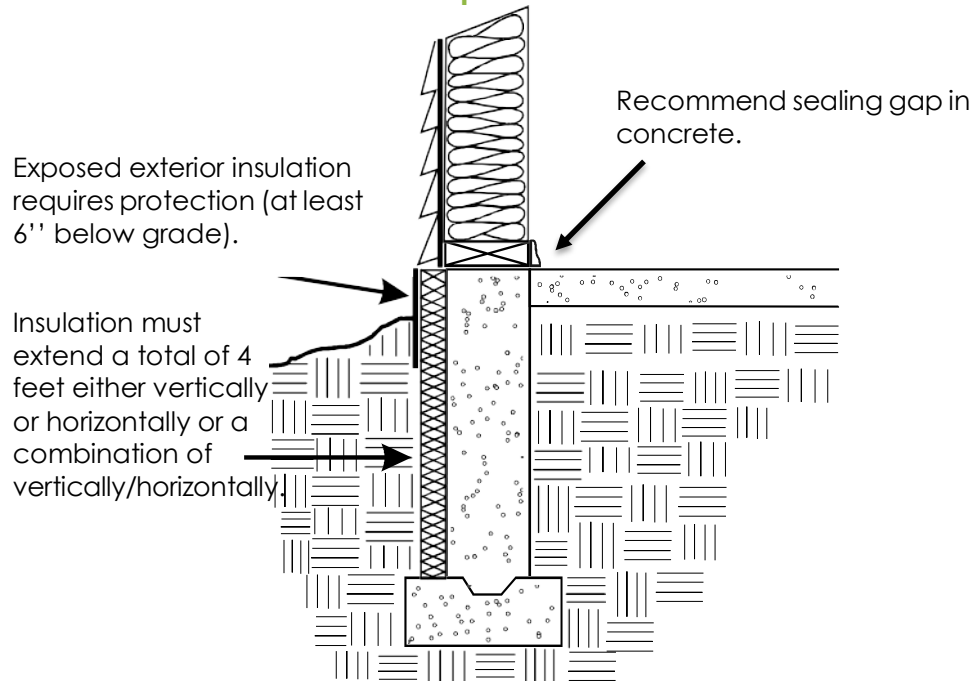


Option 2

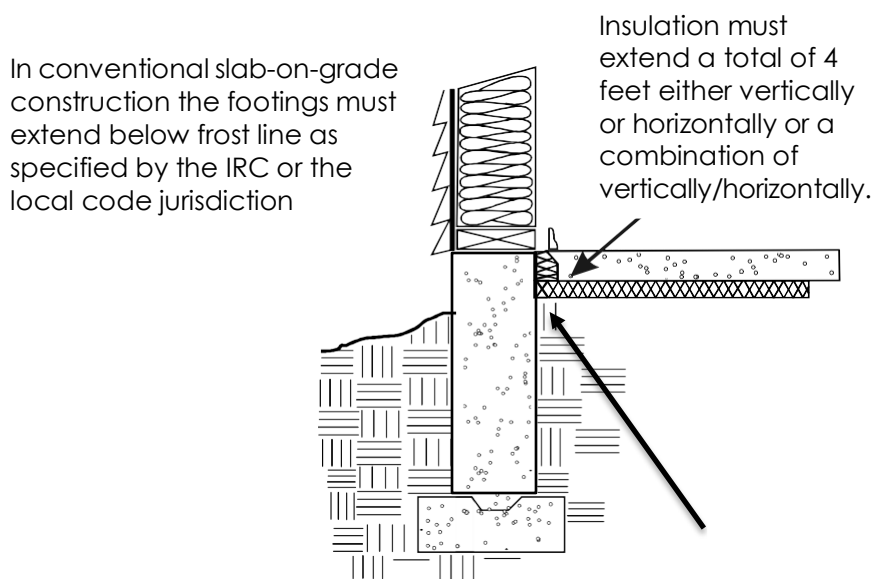


Option 3

2012 IRC Section 403.3 allows frost protected shallow foundation footing depth of 2 feet.

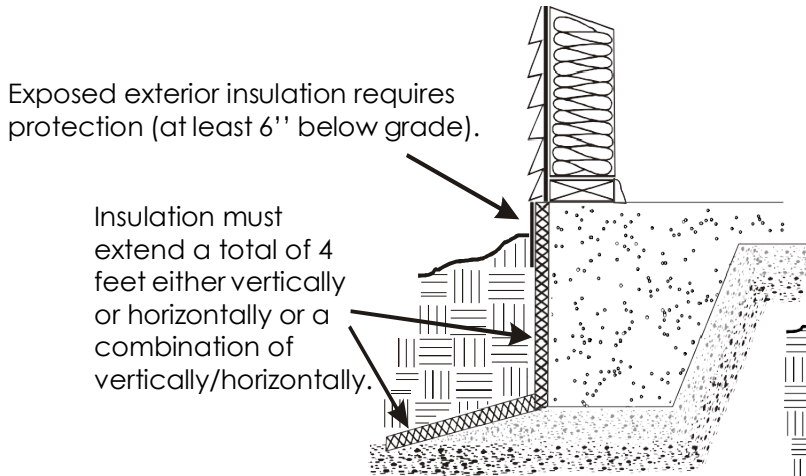


Option 4

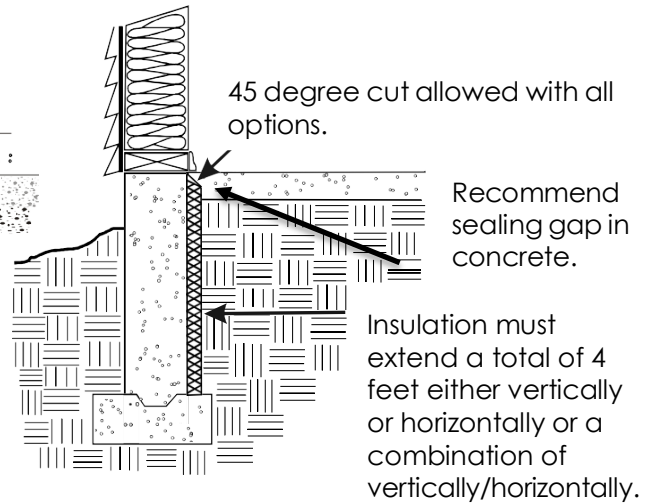

Vented Non-Heated Crawlpace with Floor Insulation

An option for insulating a crawlspace is to insulate the floor and install code-required venting. This option treats the crawlspace as an unconditioned space. Insulation levels are listed in Table 1 under the floor requirements or follow REScheck™ results for the building. Venting, air sealing, heating system sealing, duct, and pipe insulation requirements are listed on figure 2.

Figure 2

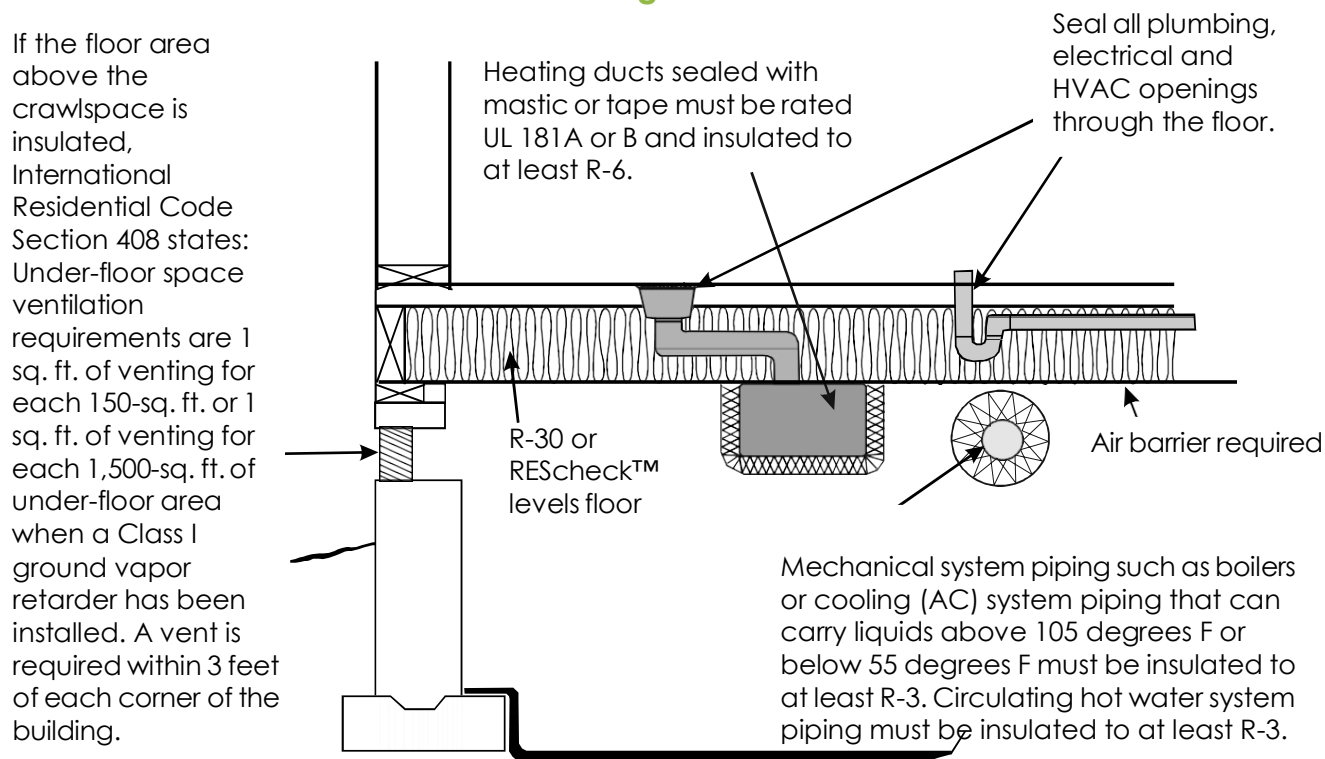

Unvented Heated Crawlpace with Insulated Foundation Walls

As an alternative to insulating floors over a crawlspace, crawlspace walls may be insulated when the crawlspace is not vented to the outside. Temporary crawlspace vent openings are allowed during construction. These vent openings must be closed, sealed, and insulated to the same R-value of the surrounding crawlspace wall when construction is complete and prior to final inspection. Crawlspace wall insulation must be permanently attached to the wall and cover the entire height of the crawlspace wall. Exposed earth in the unvented crawlspace must be covered with a continuous class 1 vapor retarder, such as 6 mil polyethylene. All joints of the ground cover must be overlapped at least 6 inches and be sealed or taped. The edges of the ground cover must extend at least 6 inches up the foundation wall and be attached to and sealed to the foundation wall. See figure 3, page 7.

Unvented Heated Crawlpace requires air flow with an exhaust or supply air option.


Exhaust Air Option

This code option requires continuously exhausted air from the crawlspace at a rate of 1 cubic foot per minute (cfm) for each 50 square feet of crawlspace. The ground in the crawlspace must be covered with a Class 1 vapor retarder, such as 6 mil polyethylene. Section 408.3 of the IRC requires an air pathway to the common area (such as a duct or transfer grille).

Crawlspace Exhaust Air Option

Figure 3

A sealed vapor retarder is part of a radon mitigation system. See figure 5, page 14. Note: Radon mitigation systems are not required by the energy code.

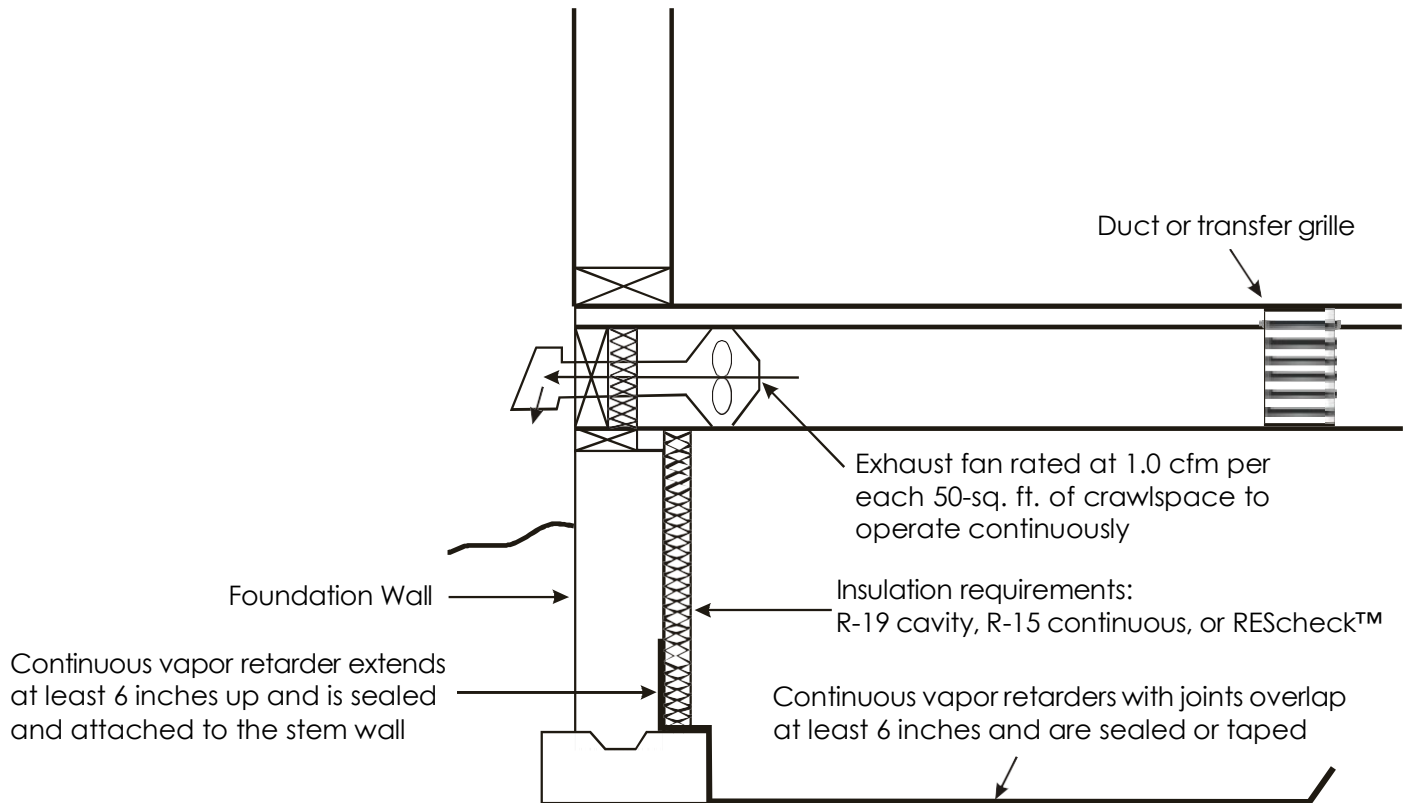

Section 408.3 of the IRC requires the exposed earth to be covered with a continuous vapor retarder. Joints of the vapor retarder must be overlapped by 6 inches and must be sealed or taped. The edges of the vapor retarder must extend at least 6 inches up the stem wall and be attached to and sealed to the stem wall.

Supply Air Option

This code option is accomplished by supplying a small amount of airflow into the crawlspace; 1 cfm of airflow for each 50 square feet of crawlspace. Below are three ways used for supplying air into crawlspaces:

1. Heat recovery ventilator providing supply and return air
2. Heating/air conditioning system providing supply air
3. Supplemental fan providing supply air

During the season when the heating/air conditioning system would not be operating, the recommendation is to have the air handler or supplemental fan cycled on for 5 minutes each hour.

The IRC requires an air pathway from the crawlspace to the common area (such as a duct or transfer grille). See figure 3, above.

Air Sealing Requirements – Section R402.4

Uncontrolled air leakage in the building envelope can significantly increase heating bills, allow warm moist interior air to enter building cavities, with potential for moisture damage, and cause uncomfortable drafts. Therefore, the energy code requires an air barrier for control of air leakage. The Montana energy code requires compliance with the Air Barrier and Insulation Installation requirements, and requires the house tightness be blower door tested.

Blower Door Test – Section R402.4.1.2 (Montana Amended)

A blower door test measurement of building air tightness showing four air changes per hour or less when tested at 50 Pascal (4 ACH50) is required. A blower door test is performed using a large fan assembly placed in an exterior door opening. The fan draws air out of the building while measuring the air flow required to create a pressure difference of 50 Pascals with reference to outside. Where required by the code official, testing shall be conducted by an approved party. Multi-unit residential buildings may be tested as an entire building or individual units may be tested. For dwelling units less than 1500 sq.ft. a test measurement showing .30 cfm per sq foot or less is an option for compliance.

Air Barrier and Insulation Installation Requirements

An air barrier is one or more materials joined together in a continuous manner to restrict or prevent the passage of air through the building envelope and its assemblies.

The energy code includes table R402.4.1 that lists the air barrier and insulation installation requirements for sixteen building envelope components.

Some of the requirements of that table are listed below.

Insulation placed in the thermal envelope of the building (walls, ceilings, dropped ceilings/soffit, rim joists, fireplace walls, shower/tub) must be in substantial contact and continuous alignment with the building envelope air barrier. See figure 4, page 11.

Some of the air leakage (visual checklist) areas that must be sealed with an air barrier material, durable caulk, or foam sealant are:

1. Openings between the building structure and exterior windows and door frames
2. Openings around electrical wire, boxes, recessed light fixtures, and plumbing piping through the attic, exterior walls, and other unheated spaces
3. Dropped ceilings or chases adjacent to the thermal boundary
4. Behind tub and showers on exterior walls
5. Common walls between dwelling units
6. Attic access openings, drop-down stairs, and knee-wall doors
7. Rim/band joist junctions
8. Top plate at exterior walls
9. Electrical /communication boxes on the thermal boundary (exterior walls and ceilings) must be air sealed or NEMA OS4 listed.
10. HVAC registered boots
11. Recessed lighting – recessed lighting installed in the thermal envelope shall be airtight, IC rated and sealed to the drywall
12. Fireplace – An air barrier shall be installed on fireplace walls and fireplaces shall have gasketed doors

Some of these locations are shown on figure 4. Note: Fiberglass and cellulose are not an acceptable air barrier material. Generally, the facing materials used on fiberglass batt insulation cannot be adequately sealed to be considered an air barrier.

Insulation Installation Requirements

Batt insulation must be cut to fit around wiring, piping and fill narrow cavities and must be in contact with the air barrier. Wall corners and headers located in the thermal boundary must be insulated.

Insulation markers must be placed facing the attic access showing the thickness of insulation. The markers must be placed at least one every 300 square feet throughout the attic.

Eave baffles are required in vented attics insulated with air permeable insulation (fiberglass and cellulose). The baffles (any solid material) must extend from the soffit and eave vents, over the top of the insulation and maintain an opening at least the size of the vent.

Mechanical Ventilation Requirements – Section R403.6

Kitchen and Bathroom Exhaust Fan Requirements

Kitchen fans must provide at least 100 cfm (cubic feet per minute) intermittent or 25 cfm of continuous air flow. Bathroom-toilet room fans must provide at least 50 cfm of intermittent or 20 cfm of continuous air flow. Bathroom and toilet room fans must be vented/exhausted to the outdoors; these fans cannot discharge into the attic, crawlspace, or any area inside the building.

Mechanical ventilation systems (bath and kitchen exhaust fans) are required to pass an air flow test. Kitchen hoods are exempt if they have at least 6-inch duct, vented to exterior and with not more than one elbow.

Whole House Mechanical Ventilation Requirements

The energy code requires a whole-house mechanical ventilation system that at least meets the specifications listed in International Residential Code (IRC) or International Mechanical Code (IMC). Those requirements can be accomplished by installing a fan in a bathroom, utility room, hallway, or another location, sized according to the square-foot size of the house and number of bedrooms as specified on the following IRC Table M1505.4.3(1).

IRC Table M1505.4.3.(1)

Continuous whole-house mechanical ventilation system airflow rate requirements in cubic feet per minute:

Dwelling Unit Floor Area (sq. ft.)	Number of Bedrooms				
	0 to 1	2 to 3	4 to 5	6 to 7	More
<1,500	30	45	60	75	90
1,501 – 3,000	45	60	75	90	105
3,001 – 4,500	60	75	90	105	120
4,501 – 6,000	75	90	105	120	135
6,001 – 7,500	90	105	120	135	150
>7,500	105	120	135	150	165

If non-continuous ventilation is provided, then the capacity of the fans must be increased as specified by table M1505.4.3.(2).

Table M1505.4.3.(2)

Intermittent Whole-House Mechanical Ventilation Rate Factors

Run-Time Percentage in Each 4-Hour Segment	25%	33%	50%	66%	75%	100%
Factor	4.0	3.0	2.0	1.5	1.3	1.0

Optional mechanical ventilation rate in cfm = (.01 X total sq. ft. area of house) + (7.5 X [number of bedrooms + 1]).

Example - a 1600 square foot, 3-bedroom house requires (.01 X 1600) + (7.5 X 4) = 46 cfm

The mechanical ventilation rate may be reduced by 30% if conditions listed in M1505.4.3 are met.

The whole-house mechanical ventilation fan must meet minimum efficiency requirements. Bathroom and utility room fans less than 90 cubic feet per minute (cfm) must deliver at least 2.8 cfm per watt. Fans larger than 90 cfm, range hoods, and in-line fans, must deliver at least 3.5 cfm per watt.

TABLE R403.6.2
WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM FAN EFFICACY*

FAN LOCATION	AIR FLOW RATE MINIMUM (CFM)	MINIMUM EFFICACY (CFM/WATT)
HRV or ERV	Any	1.2 cfm/watt
In-line fan	Any	3.8 cfm/watt
Other exhaust fan	<90	2.8 cfm/watt
Other exhaust fan	≥90	3.5 cfm/watt
Air-handler integrated to tested and listed HVAC equipment	Any	1.2 cfm/watt


*When tested in accordance with HVI Standard 916.

Additional Efficiency Package Options R408

One additional feature must be added to the house. Options listed below.

1. Enhanced envelope performance. An analysis showing the overall total building envelope (UA) is 95 % or less of the (UA) of an identical proposed minimum code building.
2. Installation of at least 95% furnace / 16 SEER air conditioner.
3. Installation of at least 10 HSPF/16 SEER air source heat pump.
4. Installation of at least 3.5 COP ground source heat pump
5. Installation of at least 82 EF (gas) water heater or 2 EF electric water heater.
6. Installation of at least 0.4 solar fraction solar water-heating system.
7. 100 % of ducts and air handler located entirely within the building's thermal envelope.
8. 100% of ductless thermal distribution or hydronic thermal distribution system located completely inside the building's thermal envelope.
9. Achieve air leakage rate of 3 ACH 50 or less and install HRV or ERV with at least 75% sensible recovery efficiency.

Figure 4 – Air Sealing and Prescriptive Path Insulation Requirements

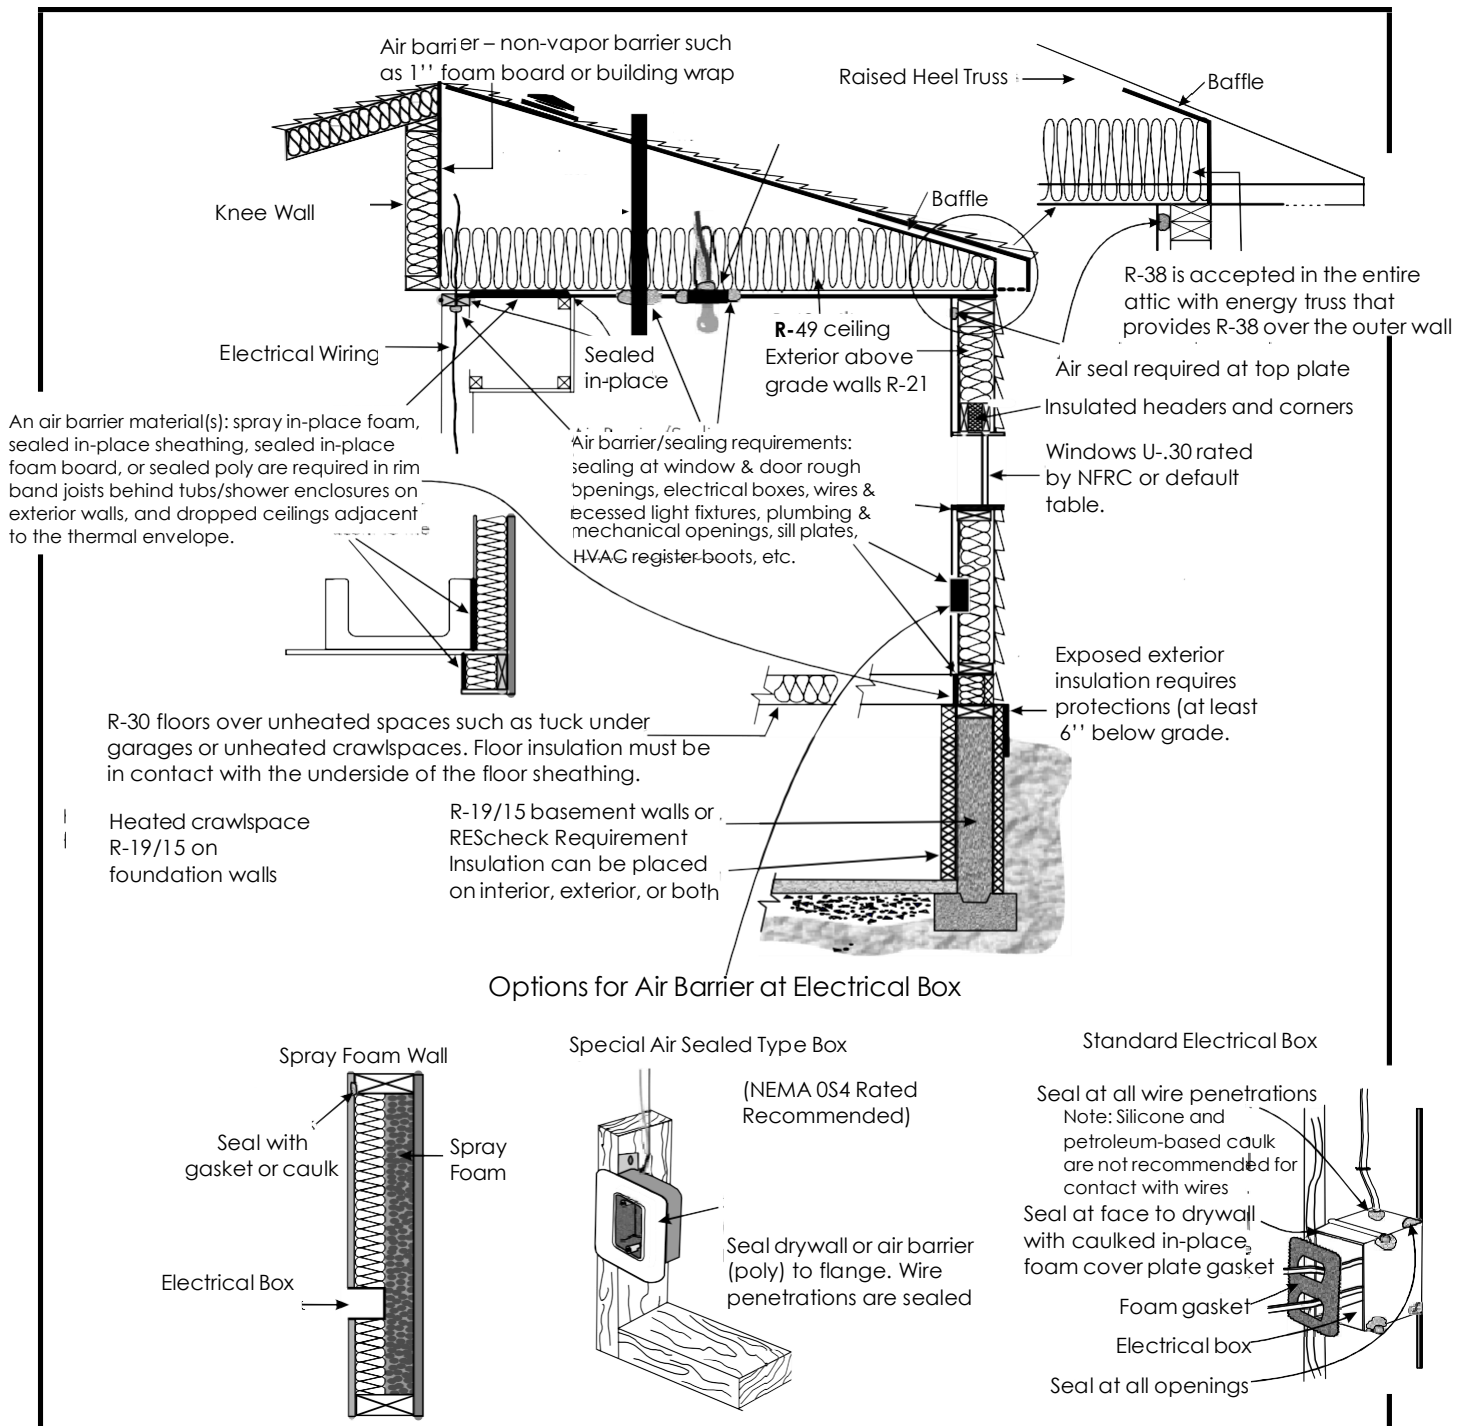

Recessed Light Requirements – Section R402.4.5

Recessed lights that are installed in the building thermal envelope (typically a ceiling with unheated space above) must be sealed to limit air leakage between conditioned and unconditioned spaces. All recessed lights must be IC rated and labeled as meeting ASTM E 283. All recessed lights shall be sealed with a gasket or caulk between the housing and interior ceiling or wall covering.

Rooms Containing Fuel Burning Appliances – R402.4.4

Where air ducts provide outside air to an open combustion fuel burning appliance (typical gas water heater) the appliance must be located in an isolated and sealed room with walls, floors and ceilings insulated to at least basement insulation requirements and with a gasketed door **or** the appliance must be located outside the building thermal envelope. Combustion air ducts passing through conditioned space must be insulated to at least R-8. Exemptions are fireplaces, stoves with exterior air supply and sealed combustion appliances.

Systems – Section R403

Programmable Thermostats – Section R403.1.1

Programmable thermostats are required on forced air (furnaces). The thermostat must be able to setback or temporarily operate the system to maintain temperatures down to 55 degrees or up to 85 degrees. It must be initially programmed with a heating temperature no higher than 70 degrees and a cooling temperature no lower than 78 degrees.

Hot water boilers must have an outdoor setback control that decreases the boiler water temperature based on the outside temperature.

Heat pumps with supplementary electric resistance heat must have controls that, except during defrost, prevent supplemental heat operation when heat pump compressor can meet the heating load.

Duct Insulation – Section R403.3.1.1

Supply and return ducts (3 inches in diameter and larger) located outside conditioned space must be insulated to at least R-8. Ducts smaller than 3 inches in diameter located outside conditioned space must be insulated to at least R-6. Supply and return ducts buried within ceiling insulation must have at least R-8 and surrounded by at least R- 19, excluding R-value of duct insulation. To be considered inside conditioned space the ducts must be inside the air barrier, usually the drywall ceiling.

Duct Sealing and Testing – Section R403.3.2 Montana Amended

All ducts, both supply and return, air handlers, filter boxes, and building cavities used as ducts, shall be sealed. Building cavities cannot be used for supply ducts. Building framing cavities may be used as return ducts if there are no atmospherically vented combustion appliances in the house outside of a sealed and insulated room that is separated from conditioned space and if the duct system is tested having total leakage no more than 4 cfm per 100 square feet of conditioned space of the house.

Ducts located outside conditioned space must be tested for tightness. The total leakage allowed for both the rough-in and post construction test must be no more than 4 cfm per 100 sq. ft. of conditioned floor area. If the air handler is not installed at time of test the total leakage must be no more than 3cfm per 100 sq. ft. of conditioned space.

Duct testing is not required for heat or energy recovery ventilation systems not integrated with heating or cooling systems.

Duct leakage testing is not required if all ducts and the air handler are located within the thermal envelope.

Mechanical System Pipe Insulation – Section R403.4

Mechanical system piping such as boiler or cooling (AC) system piping that can carry fluids above 105 degrees F or below 55 degrees F must be insulated to at least R-3.

Circulating hot water system piping must be insulated to at least R-3. These systems must also include automatic or readily accessible manual switch that can turn off the hot water circulating pump when the system is not operating.

Hot Water Pipe Insulation – Section R403.5.2

R-3 insulation is required for the following:

- ☐ Piping ¾ inch diameter and larger
- ☐ Piping serving more than one dwelling unit
- ☐ Piping located outside conditioned space
- ☐ Piping from the water heater to a distribution manifold
- ☐ Piping located under a floor slab. (not part of in-floor heating system)
- ☐ Buried piping
- ☐ Supply and return piping in recirculating systems other than cold water pipe return demand recirculation systems

Proper Sizing of Heating and Cooling Equipment – Section R403.7

Heating and cooling equipment sizing shall be based on building loads calculated in accordance with ACCA Manual S & J or other approved heating and cooling calculation method. In the past many heating and cooling systems were oversized, resulting in increased installation and operating costs.

Lighting Requirements – Section R404

All permanent light fixtures must be high-efficacy lighting sources.

Exterior Lighting Controls – Section R404.3

Where the total permanently installed exterior lighting power is greater than 30 watts, the lighting must be controlled by a manual switch which permits automatic shut off actions. Lighting serving multiple dwellings are exempt.

Lights must automatically shut off when daylight satisfies the lighting needs. Override controls are allowed if they return automatic control to normal within 24 hours.

Existing Buildings – Chapter 5

Additions, alterations, or repairs to an existing building or building system must comply with the energy code. Unaltered portions of an existing, lawfully in existence at the time of adoption of this code, need not comply with the energy code.


The following alterations are exempt from the energy code provided that the energy use in the building is not increased.

- ☐ Storm windows over existing windows.
- ☐ Existing ceiling, wall, or floor cavities exposed during construction provided they are filled with insulation.
- ☐ Construction where the existing roof, wall or floor cavity is not exposed.
- ☐ Roof re-cover.
- ☐ Roofs without insulation in the cavity and where the sheathing or insulation is exposed during re-roofing shall be insulated either above or below the sheathing.
- ☐ Surface applied window film installed on existing single pane fenestration assemblies to reduce solar heat gain provided that the code doesn't require window replacement.
- ☐ Heating ducts extended less than 40 feet in unconditioned space need not be tested.
- ☐ Spaces undergoing a change in occupancy resulting in an increase energy demand must comply with the energy code.
- ☐ New building sections are exempt from the blow door testing requirement.

Radon Mitigation

Because of the potential for high indoor levels of radon, the Montana Department of Environmental Quality recommends new houses have basic radon mitigation systems installed during construction. Contact the Montana Radon hotline for more information at 1-800- 546-0483.

Figure 5 – Radon Mitigation System in Crawlspace (not required by code)

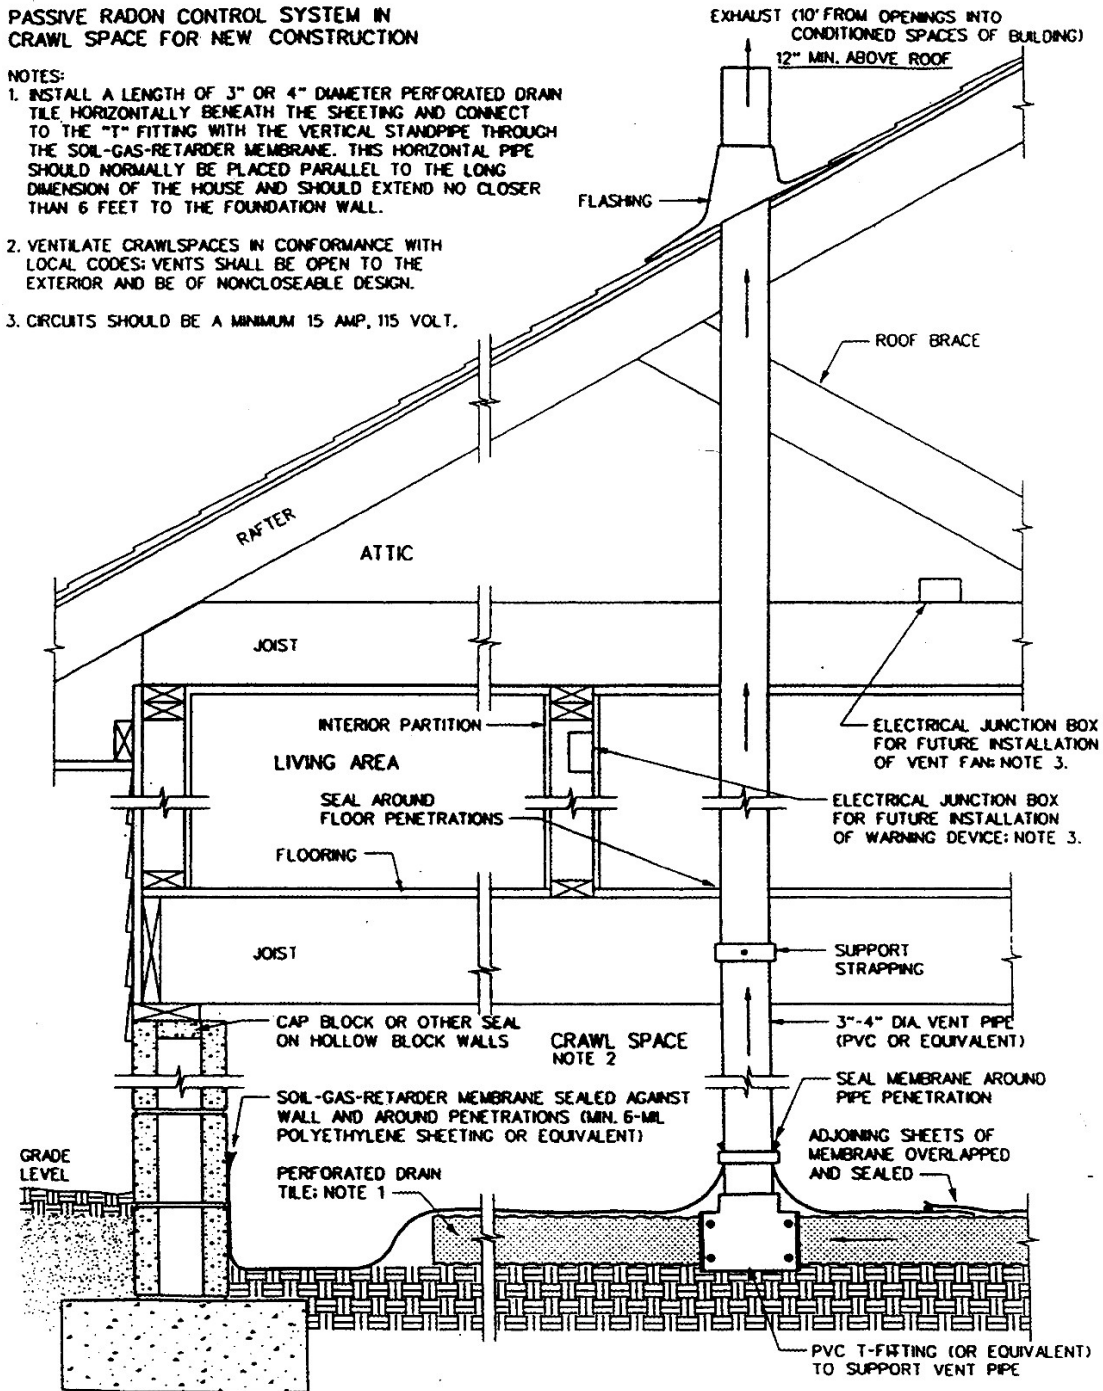

Labels are available at no cost from many sources. Several utility companies distribute labels as a public service. Local Montana Homebuilder Association offices in Billings, Bozeman, Great Falls, Helena, Kalispell, and Missoula distribute labels to their members. Labels are also available from the Montana Department of Environmental Quality's Energy Bureau at 1520 East 6th Avenue in Helena, Montana. You can also call the Energy Bureau at 406-444-0281 for information. Blank printable copies are also available on our website at deq.mt.gov/Energy/eec/EnergyCode.

ENERGY CODE COMPLIANCE LABEL

Address: _____

Ceiling: Flat R 49
 Vaulted R 38

Walls Above grade walls R 21
 Basement walls R19/15
 Crawlspace walls R19/15

Floors: Over unheated spaces R 30
 Perimeter slab for 4 feet R 10
 Under slab for _____ feet _____ full R - _____

Exterior doors: U 30

Windows: NFRC unit rating U 30

Water heater: Energy factor (EF) rating .67

Heating system: Energy efficiency rating 80%
 (AFUE for gas; HSPF heat pump)

Cooling system: EER _____ SEER _____

Heating ducts: Systems sealed: X Yes per
 In non-conditioned areas insulated to
 Supply R- 8 Return R- 6
 Leakage test at rough in _____ or final _____
 results _____ CFM 25 per 100 sq. ft
 or N/A _____

Air Sealing: Blower door test results 4 ACH 50

Whole house mechanical ventilation: _____ Yes per code

Other (i.e., radon mitigation, solar ready) _____

Builder: _____ Date: _____

Signature: _____

*The builder or representative certifies compliance with
 ARM 24.301.161 and MCA 50-60-802, by completing and signing this label.*
 August 2021

**THIS LABEL MUST BE PERMANENTLY AFFIXED BY HOME
 BUILDERS TO THE BREAKER PANEL ON ALL NEW
 RESIDENTIAL BUILDINGS, AS REQUIRED BY SECTION 50-60-803,
 MONTANA CODE ANNOTATED AND 2021 IECC – SECTION 401.3**

Federal Residential Renewal Energy Tax Credit

A federal income tax credit of up to 30% (for systems installed in 2022), of the installation costs for a solar PV, solar water heating system, a wind turbine no larger than 100 kilowatts, geothermal heat pump and wood or pellet stoves of at least 75% efficiency is available to individuals, with no upper limit. For individuals, the system does not have to be installed on the taxpayer's principal residence. Excess credit generally may be carried forward to next tax year. The 30% Federal Credit lasts until Dec. 31, 2032. It drops to 26% in 2033, then 22% in 2034, and disappears in 2035.

Glossary of Energy Efficient Terms

A good comparison shopper needs to understand certain units of measurement, such as MPG (miles per gallon) when shopping for a new car. Shopping for energy efficiency also involves knowing a few units of measurement. Each Energy Efficiency Components Label may contain five or more different units of measurement. The following definitions will help you crack the code of energy efficiency.

R-Value – The units used to measure the insulating value of an object. The higher the R-value, the more insulating value an object has. For example, a high-density batt of fiberglass insulation for a 2" x 6" wall has an R-value of 21.

U-Value – Insulation measurement, measure heat loss through windows. The U-value of a window is the reciprocal of its R-Value ($U = 1/R$). For instance, a window with a U-value of 0.33 is equivalent to an R-value of 3 ($0.33 = 1/3$). Because the U-value is the inverse of the R-value, a lower U-value indicates a window that has better insulating capabilities than a window with a higher U-value.

BTU – A British Thermal Unit is the amount of heat energy needed to raise the temperature of one pound of water by one-degree F.

NFRC Unit Rating – The National Fenestration Rating Council (NFRC) determines the U-value for most windows. This rating is placed on a label attached to all new NFRC rated windows. If the NFRC rating is available, the home builder should use this number when filling in the U-value on the Energy Efficiency Components Label.

EF – Used to determine the energy efficiency of hot water tanks, EF is the abbreviation for Energy Factor. This unit is a ratio of the heat energy contained in the water in a hot water tank over a certain period divided by the energy that the hot water heater consumes over the same period. The most efficient electric water heaters have an EF rating of 0.93 to 0.96, while the most efficient gas-fired water heaters have energy factors ranging from 0.8 to 0.9.

AFUE – An abbreviation for Annual Fuel Utilization Efficiency, AFUE is a measure of the effectiveness of gas and oil space heating systems. All furnaces and boilers in the United States are required to have an AFUE rating of at least 78 percent. The most efficient gas furnaces have an AFUE of 92 percent to over 96 percent, while the most efficient gas hot-water boilers have AFUE ratings of around 84 percent to 95 percent. Energy-efficient oil furnaces have similar AFUE ratings, in the mid-80s to 90 percent. The most efficient oil-fired hot water boilers have efficiencies that are slightly lower, with AFUE ratings up to around 90 percent.

HSPF – Heating Season Performance Factor is the measurement unit for determining the efficiency of heat pumps. It is calculated by dividing the estimated seasonal heating output (in Btu) by the seasonal power consumption (in watts).

SEER – Seasonal Energy Efficiency Ratio. The total cooling output of an air conditioner during its normal annual usage period for cooling, in Btu/hours, divided by the total electric energy input during the same period in watt- hours.

EER – Energy Efficiency Ratio. Energy Efficiency Ratio is the ratio of the cooling capacity in BTUs per hour to the power input (in watts). The higher the EER rating, the more efficient the air conditioner.

Additional Energy Conservation Resources

Organization	Location	Website
Building American Solution Center	Washington, DC	basc.pnnl.gov
Building Science Corporation	Westford, MA	buildingscience.com
Better Built Northwest	Portland, OR	betterbuiltnw.com
Efficient Windows Collaborative	Washington, DC	efficientwindows.org
Energy and Environmental Building Association	Bloomington, MN	eeba.org
EPA Home Performance with Energy Star	Washington, DC	energystar.gov
MT. Dept. of Environmental Quality	Helena, MT	deq.mt.gov/energy
National Center for Appropriate Technology	Butte, MT	ncat.org
U.S. Department of Energy	Washington, DC	energy.gov
National Fenestration Rating Council		nffc.org
North American Insulation Manufacturers Association		insulationinstitute.org



Printed on recycled paper